
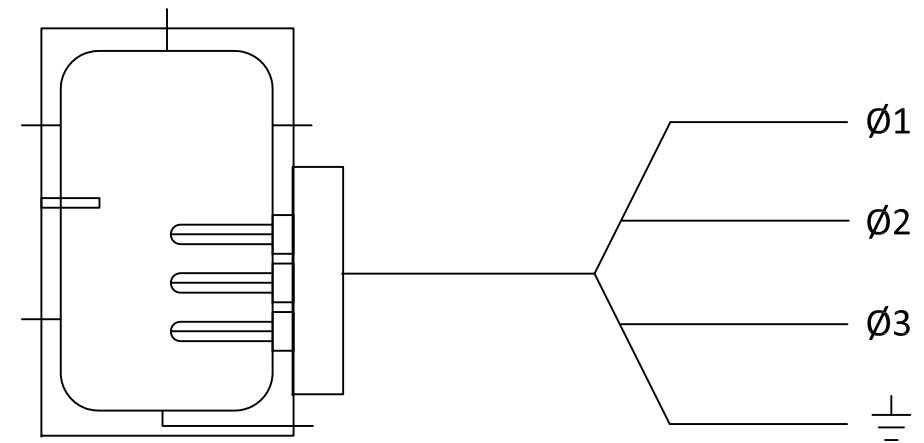


Item	Value
Heat Pump	Aegis 500A
Quantity	3
Voltage	460 V
Phase	3Ø
LRA	260 A
MCA	110 A
MOP	175 A

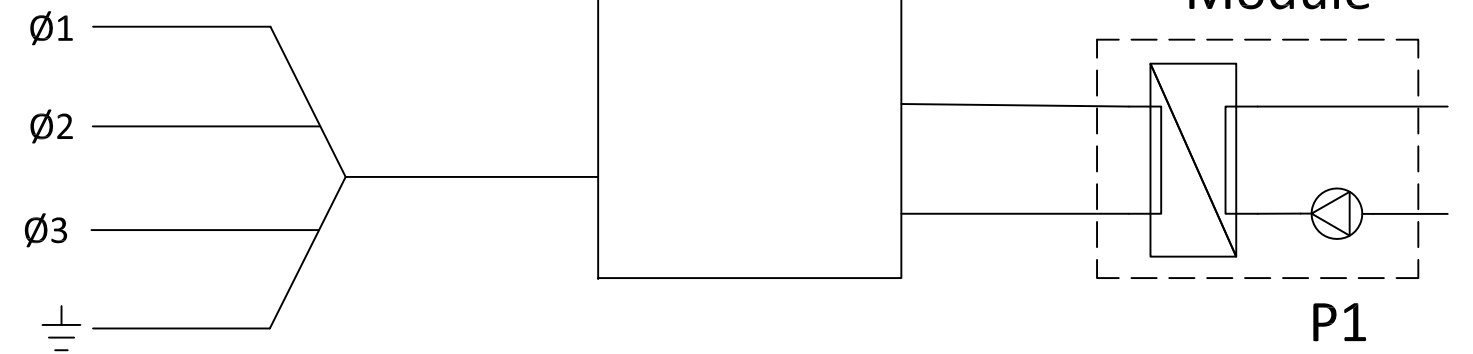


Bolt Electric Tank

Item	LCXXX-R36	LCXXX-R72	LCXXX-R108	LCXXX-R144
Voltage	480V			
Phase	3Ø			
MCA	44	87	130	174
MCP	50	90	150	175

DATA FOR BOLT TANKS ONLY.
CONSULT BOLT SUBMITTALS FOR FURTHER INFORMATION.

Item	Value
Pump	Ecocirc 20-35
Voltage	120 V
Phase	1Ø
Circuit	15 A
Dedicated Circuit	

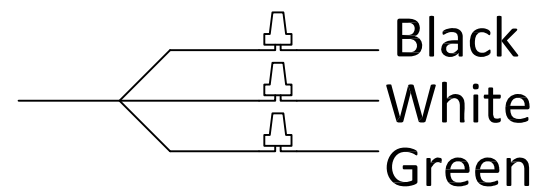


Wiring

CONNECTIONS IN ELECTRICAL BOX
CONTAINED ON HEAT EXCHANGER MODULE

NOTES:

- 1) NOT FOR CONSTRUCTION.
- 2) EACH HEAT PUMP HAS WIRING AS SHOWN.

		Blauvelt, NY Fort Worth, TX
AEGIS A500A HIGH VOLTAGE WIRING		
DWN.BY <u>K.S.</u> DATE <u>090622</u> SCALE <u>NTS</u> APPD. _____ DATE _____	SD-L-1247	REV. A