
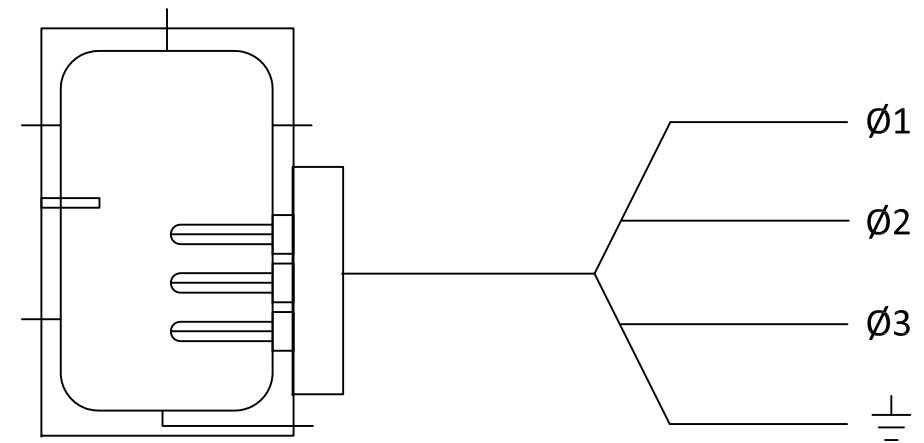


Item	Value
Heat Pump	Aegis 350A
Voltage	460 V
Phase	3Ø
LRA	203 A
MCA	72 A
MOP	110 A

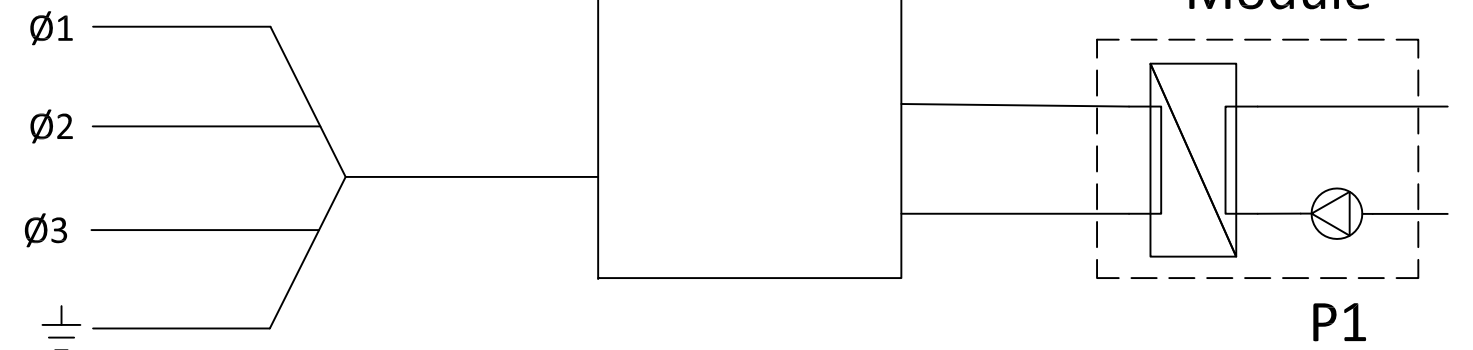


Bolt Electric Tank

Item	LCXXX-R36	LCXXX-R72	LCXXX-R108	LCXXX-R144
Voltage	480V			
Phase	3Ø			
MCA	44	87	130	174
MCP	50	90	150	175

DATA FOR BOLT TANKS ONLY.
CONSULT BOLT SUBMITTALS FOR FURTHER INFORMATION.

Item	Value
Pump	Ecocirc 20-35
Voltage	120 V
Phase	1Ø
Circuit	15 A
Dedicated Circuit	

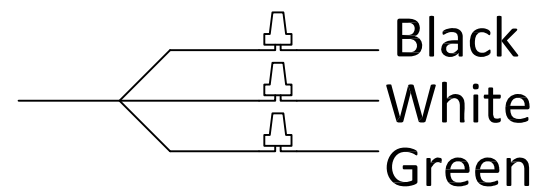

Wiring

CONNECTIONS IN ELECTRICAL BOX
CONTAINED ON HEAT EXCHANGER MODULE

NOTES:
1) NOT FOR CONSTRUCTION.

	Blauvelt, NY Fort Worth, TX
	AEGIS A350A HIGH VOLTAGE WIRING
DWN.BY <u>K.S.</u> DATE <u>090622</u> SCALE <u>NTS</u> APPD. _____ DATE _____	SD-L-1246 REV. A