



Aegis 350 A	Name
HPL90-100	Model
460 VAC	Voltage
3Ø	Phase
51 A	FLA
72 A	MCA
110 A	MOP
203 A	LRA

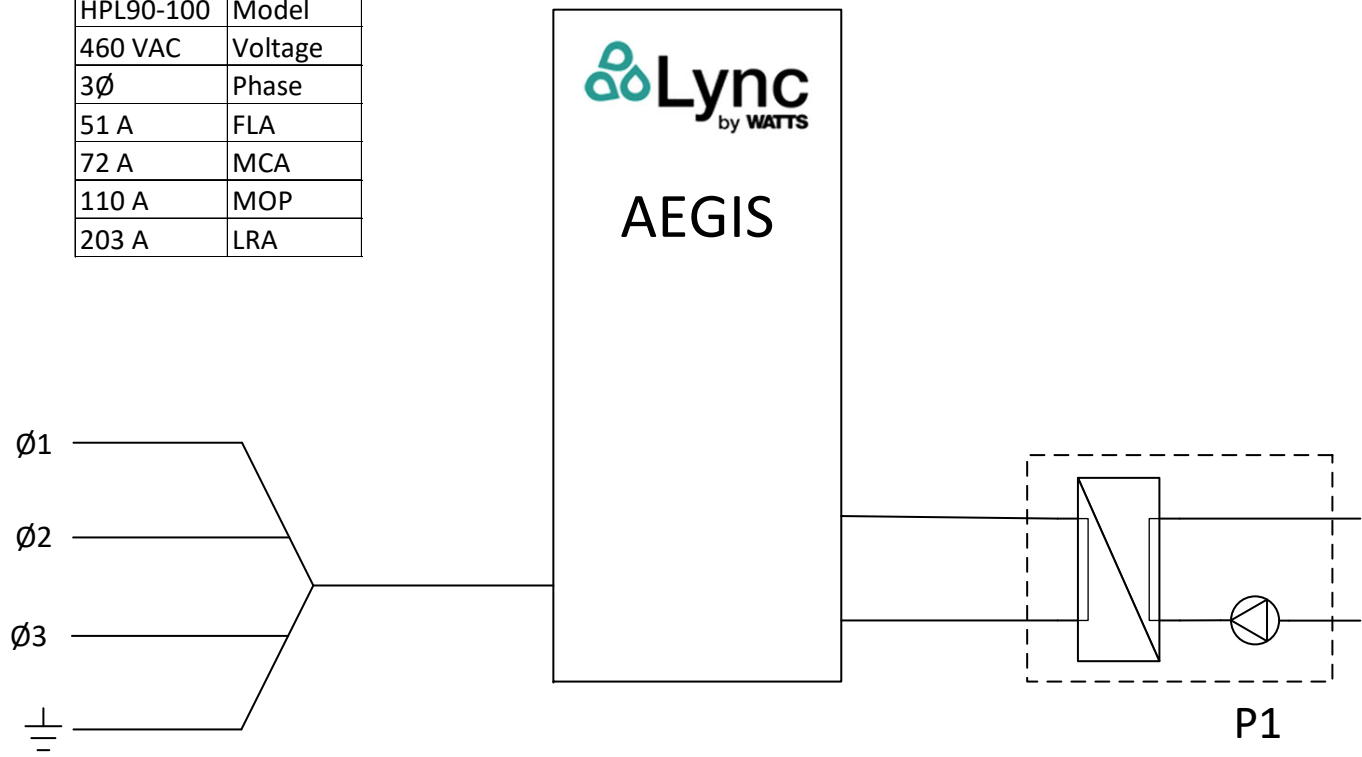


### Heat Pump Unit

Circuit	
120	VAC
15	A
Dedicated	
Primary Pump	
PL55	Model
Bell & Gossett	Manufacturer
4.7A	Current Draw
52'	Max Head
50 GPM	Max Flow
Secondary Pump	
PL36	Model
Bell & Gossett	Manufacturer
2.1A	Current Draw
40'	Max Head
40 GPM	Max Flow
Valves	
ARX120SR	Actuator
Belimo	Manufacturer
0 - 10 VDC	Signal
> 1 A	Current Draw
2	Number
Total	
8.8 A	Current Draw

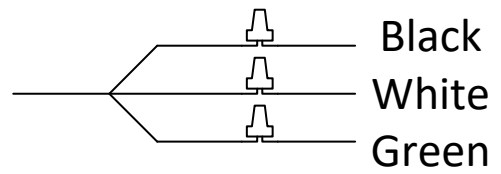

Wiring

### Pump Skid

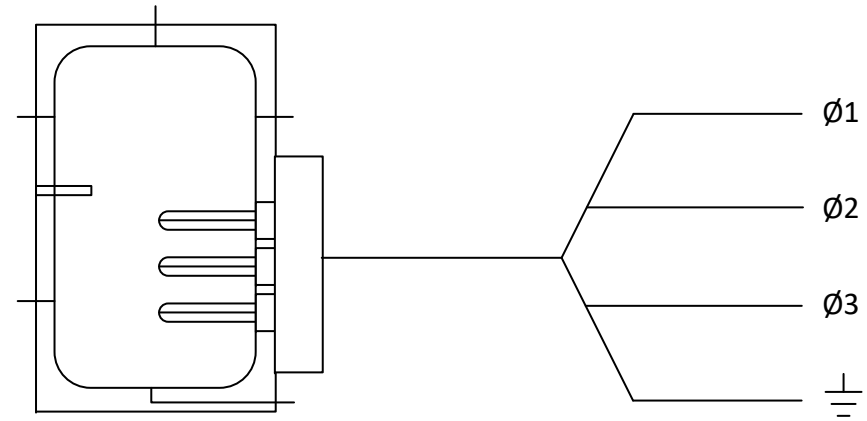

### Bolt Electric Tank

Recirculation Tank				
Item	LCXXX-R36	LCXXX-R72	LCXXX-R108	LCXXX-R144
Voltage	480V			
Phase	3Ø			
MCA	44	87	130	174
MCP	50	90	150	175

		Fort Worth, TX 76134 Blauvelt, NY 10913	
<h2>A350 ASHP AC Wiring</h2>			
DRWN. BY	DATE	DWG. NO:	REV.
04/20/23		SD-L-1246	<b>B</b>
<small>Page 3 of 46</small>			