

## Installation, Operation, & Maintenance Manual

---

# Lync Aegis Heat Exchanger Module Mark II



**Single Heat Exchanger**



**Dual Heat Exchanger**

### Disclaimer

The information contained in this document is subject to change without notice from Watts Heating and Hot Water Solutions LLC dba Lync by Watts ("Lync"). Lync makes no warranty of any kind with respect to this material, including, but not limited to, implied warranties of merchantability and fitness for a particular application. Some states do not allow the exclusion or limitation of incidental or consequential damages, so the above limitation may not apply. Lync is not liable for errors appearing in this document, not for incidental or consequential damages occurring in connection with the furnishing, performance, or use of these materials.

**CONTENTS**

**SECTION 1. SAFETY CONSIDERATIONS ..... 3**

1.1. General Warnings ..... 4

1.2. Safety Precautions..... 4

**SECTION 2. INTRODUCTION..... 5**

2.1 Models..... 5

2.2 Main Components ..... 5

2.3 Unit Control ..... 6

2.4 Sequence Of Operation..... 6

**SECTION 3. INSTALLATION..... 8**

3.1 Spaces For Installation ..... 8

3.2 Storage..... 8

3.3 Lifting And Transport..... 8

3.4 Available Pump Head..... 9

3.5 General Recommendations For Hydraulic Connection ..... 9

3.5.1 Recommended Hydraulic Circuit..... 10

3.5.2 Key Considerations For Water Piping..... 11

3.6 Hydraulic Connection To The Heat Pump ..... 11

3.7 Water Composition..... 11

3.8 Discharge of Safety Valves ..... 12

**SECTION 4: WIRING AND ELECTRIC CONNECTIONS ..... 13**

4.1 Overview ..... 13

4.2 Low Voltage and Sensors ..... 13

4.3 High Voltage..... 14

4.4 Controller Function..... 14

**SECTION 5: STARTUP ..... 15**

5.1 Preliminary Verifications ..... 15

5.2 Filling the unit ..... 16

**5.3 Verifications During Operation ..... 16**

**SECTION 6. DECOMMISSIONING ..... 17**

6.1 Seasonal Shutdown ..... 17

6.2 Emergency Stop..... 17

**SECTION 7. PERIODIC MAINTENANCE AND INSPECTIONS..... 18**

7.1 Overview ..... 18

**SECTION 8. TROUBLESHOOTING ..... 19**

**SECTION 9. DISPOSAL OF THE UNIT ..... 19**

**APPENDIX A. MARK II SINGLE PARTS DRAWINGS ..... 20**

**APPENDIX B. MARK II DUAL PARTS DRAWINGS..... 28**

**SECTION 1. SAFETY CONSIDERATIONS****IMPORTANT!**

Read the complete installation instructions BEFORE using this equipment. Failure to read and follow all safety information and operating instructions can result in death, serious personal injury, property damage, or damages to the equipment. Keep this guide for future reference.

Accidental scalding from hot water is a greater risk in certain facilities, including:

- Homes For The Physically or Mentally Disabled
- Hospitals
- Nursing Homes and Assisted Living Facilities
- Foster And Child Care Facilities

Potable hot water should be no more than 110°F when used for bathing or other personal use anywhere contact with hot water may be slower, or the danger of hot water contact is greater.

**IMPORTANT!**

- Always follow local code requirements and the rulings of authorities having jurisdiction.
- Thermostatically controlled mixing valves must be used in the design of the potable hot water system.
- Good engineering practice mandates that thermostatically controlled mixing valves are set at 120°F or less to keep the delivered water temperature below scalding temperatures. It only takes five seconds of skin contact with 140°F water to cause a second degree burn. You must protect against high water temperatures in all sinks, tubs, showers and other points of hot water contact.

**⚠ WARNING!**

- If the information in these instructions is not followed exactly, a fire or explosion may result causing property damage, personal injury or death. Never store or use gasoline or other flammable vapors and liquids near this or any other appliance. Installation and service must be performed by a qualified installer, or service agency who must read and follow the manual before installing, servicing, or removing the unit.
- Improper installation, adjustment, alteration, service or maintenance can cause property damage, personal injury, exposure to hazardous materials, or death. Never not use matches, candles, flames, or other sources of ignition to check for gas leaks.
- Fluids under pressure may cause injury to personnel or damage to equipment when released. Be sure to shut off all incoming and outgoing water shutoff valves and carefully decrease all trapped pressures to zero before performing maintenance.
- The electrical connection cover must be installed at all times, except during maintenance.
- A disconnect switch must be installed at the electrical service connection per local codes.

**IMPORTANT!**

This manual contains information required for the installation, operation and maintenance of the Lync AEGIS HEAT EXCHANGER Module. Read and follow the information in this and all other provided instructions, labels and markings before installing, operating or servicing this equipment.

**1.1. General Warnings**

Read the following before continuing:

- This manual is an integral part of the product and must be kept for consultation.
- The unit must not be used with functions other than those described.
- Before continuing, check the application limits.
- The company reserves the right to change the composition of its products without notice.

**1.2. Safety Precautions**

- Use the module only within the intended operating limits.
- Make sure cables for the probes and the power supply are kept separate without twisting.

For applications in especially critical industrial environments, it may be useful to use network filters.

**CAUTION!**

Disconnect all electrical connections before starting any maintenance work. As with any electrical product, care should be taken to guard against the potential risk of fire, electric shock, and injury to persons.

**SECTION 2. INTRODUCTION**

The Aegis Heat Exchanger Module is designed to supply domestic hot water as part of a Lync Aegis heat pump water heater system. The Heat Exchanger Module serves several key functions:

- Provides flexible flow conditions to HP which can minimize cycling and improve efficiency
- Protects refrigerant loop gas cooler against potential degradation from incoming city water
- Allow a glycol primary loop for outdoor air-source installations in freezing conditions while providing double-wall separation


The Heat Exchanger Module is designed in-house with HP selection criteria to reduce engineering time and complexity versus ‘stick built’ alternatives. It is manufactured with quality WATTS components to provide true single point accountability.

**2.1 Models**

The Heat Exchanger comes in two versions: single heat exchanger for use with Aegis 250 units, and dual heat exchanger for Aegis 350 and 500 units.

The model, serial number, voltage, and maximum working pressure are shown on labels affixed to the machine.


| LYNC®<br>AEGIS INTERMEDIATE SKID |               |  |             |      |
|----------------------------------|---------------|--|-------------|------|
| MODEL NO.                        | SERIAL NUMBER | MFG. DATE                              |             |      |
| LC3.5CMI-LC5.0CMI                | F012345       | 03-2024                                |             |      |
| INPUT<br>Btu/h                   | INPUT<br>kW   | WORKING PRESSURE<br>(HYDROSTATIC TEST) |             |      |
| 350,000-500,000                  | 100-150       | PSI                                    | kPa         |      |
|                                  |               | 150(225)                               | 1034 (1551) |      |
| ELECTRICAL                       | VOLTS         | PHASE                                  | Hz          | AMPS |
|                                  | 120           | 1                                      | 50/60       | 10   |

 MFG. BY WATTS FORT WORTH, TX  
WWW.LYNCPBYWATTS.COM  
ASSEMBLED IN THE USA

*Figure 1 – Example Heat Exchanger Module Data Label*

**2.2 Main Components**

The Aegis Heat Exchanger Module is divided into two halves, a primary (closed) loop back to the heat pump, and a secondary (domestic hot water) loop that feeds the storage tanks. Each loop has one constant speed pump. The flow in the loops is varied by a motorized valve to maintain the desired temperature in the loop. Other required primary and secondary system components, such as strainers, relief valves, expansion tank, isolation valves, unions, a thermowell, and filling/discharge points are also included.

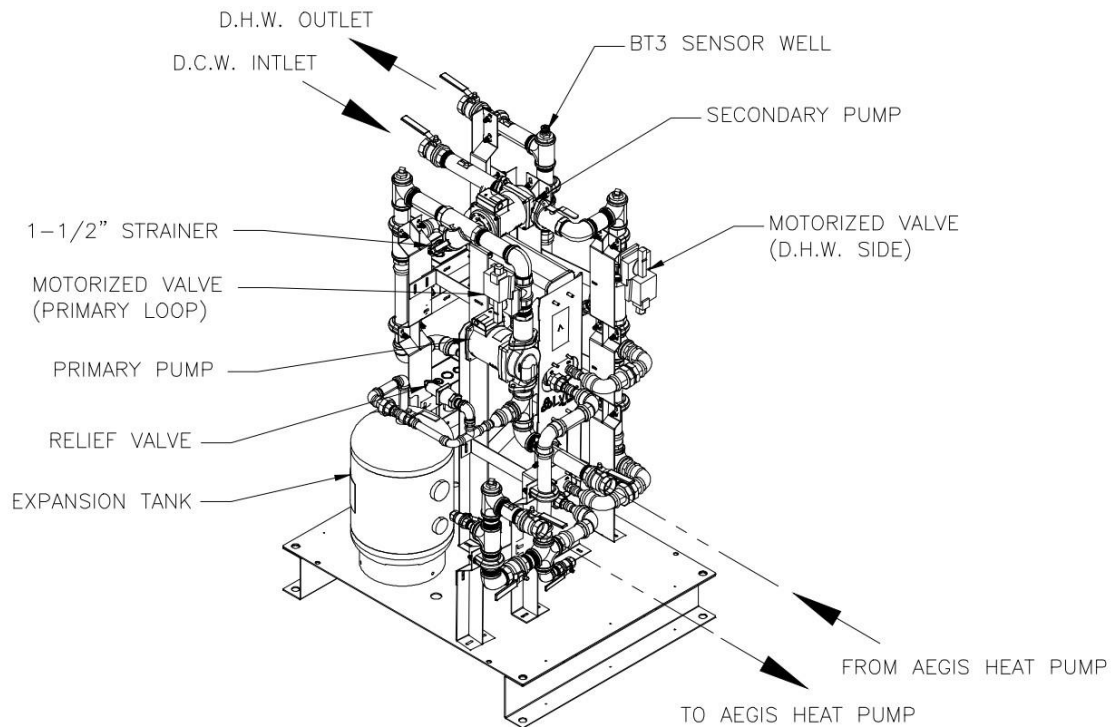

**Figure 2 – Mark II Heat Exchanger Module Major Components**

### 2.3 Unit Control


The primary and secondary loop temperatures are controlled by adjusting the water flow rate through the use of modulating valves. The Aegis is responsible for sending control signals to these valves as well as communicating with all required temperature sensors. Descriptions of the Aegis wiring and control points may be found in L-OMM-013 Lync Aegis Electronic Controller Manual.

Additionally, the Aegis heat pump control manages the circulation of water in order to ensure that the correct temperature rise in the system is maintained. This will determine the need for hot water recovery by monitoring the water temperature in the storage tanks.

### 2.4 Sequence Of Operation

The hot water storage tanks used in this heating system must be equipped with the provided temperature sensors, or other sensors meeting requirements for a NTC 10k temperature sensor. The (BT1) sensor (cold side probe) is placed in the bottom of the first storage, near cold return water connection. The BT2 sensor (hot side probe) is located in the top of the last storage tank in the series, near the supply outlet.

The BT3 sensor is located on the outlet of the external heat exchanger and is used to control the temperature rise across the Heat Exchanger Module. Installation of BT1, BT2, and BT3 probes must be done by the installer prior to operation.

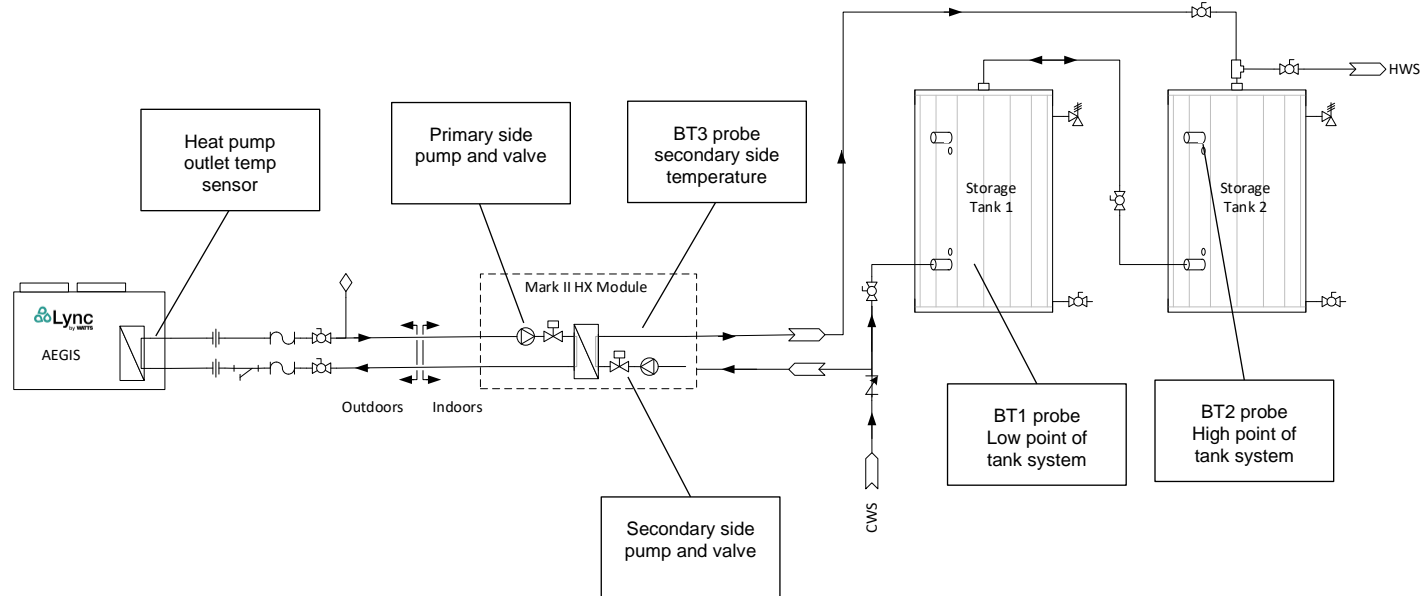

**Figure 3: Probe Locations**

When the temperature probe BT1 reaches the value "Set point unit ON", (set point (ST03) minus differential (ST04)), the unit will be turned on. The unit will continue to heat the water to the set temperature as long as the temperature BT1 remains below the "Set point unit OFF" value (ST03). Once BT1 reaches "Set point unit OFF" the unit will be turned off.

The heat pump's outlet sensor will control the primary loop to a fixed temperature setpoint ST01, modulating the primary side valve and flow rate to maintain outlet temperature.

The Aegis also manages the secondary valve (domestic hot water loop) position according to the BT3 probe. The BT3 probe measures the temperature out of the heat exchanger module and into the storage tanks. This temperature is controlled by ST01 plus an offset setpoint SP02. For the Mark II heat exchanger module this offset is set to  $-10^{\circ}\text{F}$ . For example, if ST01 is set to  $170^{\circ}\text{F}$  and offset SP02 is  $-10^{\circ}\text{F}$ , the secondary loop valve will control to a setpoint of  $160^{\circ}\text{F}$  into the storage tanks. Please see Aegis Electronic Controller Manual (L-OMM-013) for further details.

## SECTION 3. INSTALLATION

The Aegis Heat Exchanger Module is available in indoor and outdoor versions. The outdoor configuration includes a sheet metal enclosure to protect against rain. If freezing conditions are expected, an appropriate glycol-water solution must be used to prevent accidental freeze damage when the heat pump is not operating. Lync recommends no greater than 40% glycol in any application due to potential viscosity and corrosion concerns. For specific recommendations on glycol types, fill percentages, and specific heat changes, contact your glycol manufacturer.

The following must be taken into account when choosing where to install and connect the unit:

- size and origin of the hydraulic piping
- location of the power supply
- accessibility for maintenance or repairs
- stability of the support surface
- orientation and exposure to solar radiation
- possible sound reverberation

The clearances specified in the dimensional drawing of the unit **MUST** be followed. The unit must always be anchored to the ground.

The Heat Exchanger Module ships pre-assembled on a skid base. Housekeeping pads are not required for Heat Exchanger Module installation. The unit must be installed flat and horizontally.

The Heat Exchanger Module should never be installed in the same location where chemicals are stored. Examples of such chemicals are ice melting salt and chlorine for pool treatment. This is not an exhaustive list. If there are any questions about the unit's suitability for a particular environment, contact your local Lync representative.

### 3.1 Spaces For Installation

The spaces needed to accommodate the unit are shown on dimensional drawings AP-L-1086 for the single unit and AP-L-1088 for the dual unit, available at [lyncbywatts.com](http://lyncbywatts.com).

It is advisable to leave sufficient space between the units for removing their larger components such as the exchangers and pumps.


### 3.2 Storage

The Heat Exchanger Module is drained of water prior to shipping. Small amounts of water may remain behind in the piping and in the heat exchanger(s). When transporting and storing the Heat Exchanger Module prior to installation, it must remain in storage that does not experience freezing temperatures to prevent damage to the unit.

### 3.3 Lifting And Transport

While unloading and positioning the unit, take extreme care to avoid sudden, violent movements. Avoid applying force to components of the machine. The unit may be lifted using assistance from a forklift, inserting the lifting forks in the lifting pallet (see Figure 4).



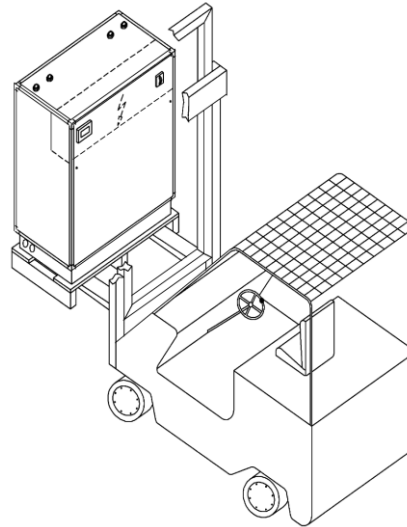

**Figure 4: Lifting the Unit with Forklift**

### 3.4 Available Pump Head

The table below shows available pump head for each Aegis model under the highest expected flow conditions.

| Model       | Available Pressure, Primary Side (ft head) | Available Pressure, Secondary Side (ft head) |
|-------------|--|--|
| Aegis A 250 | 20.6                                       | 30.2   |
| Aegis A 350 | 23.2                                       | 27.4   |
| Aegis A 500 | 17.8                                       | 20.3   |
| Aegis W 250 | 37.5                                       | 32.9   |
| Aegis W 350 | 35.2                                       | 30.1   |
| Aegis W 500 | 30.9                                       | 24.8   |

### 3.5 General Recommendations For Hydraulic Connection

**⚠ WARNING!**

The units may produce hot water at temperatures as high as 194°F (90°C). All hydronic components must be selected for this temperature.


When setting up the hydraulic circuit for the Heat Exchanger Module, users should use the tips and steps below, and remain in compliance with national and local regulations. Lync recommends users connect the piping to the heat pumps using flexible joints in order to minimize vibrations and compensate for thermal expansion.

Install the following components on the piping:

- Stop cocks, temperature and pressure indicators for maintenance and inspection.
- Sample points on the input and output pipes to read the temperature, if temperature indicators are not present.
- Shut-off valves to isolate the unit from the circuit.
- Use metal mesh filters with openings 1/16" (1 mm) or less on the exchanger inlet pipe to protect the exchanger against slag or impurities in the pipes.
- Air eliminators must be installed at the highest parts of the hydraulic circuit in order to allow excess air to be released.
- Use the expansion tank and automatic charging valve to maintain the system pressure and to compensate for thermal expansion.
- Drain valves and where necessary, drain the tank to empty the system for maintenance operations or seasonal breaks.

**IMPORTANT!**

A safety relief valve is installed on the primary side of the Heat Exchanger Module. If an over-pressure condition should arise in the system, this allows the system to be drained to prevent an explosion. Always connect the discharge pipe to a drain with a diameter no less than that of the valve opening and direct it towards the areas where the discharge cannot harm anyone.

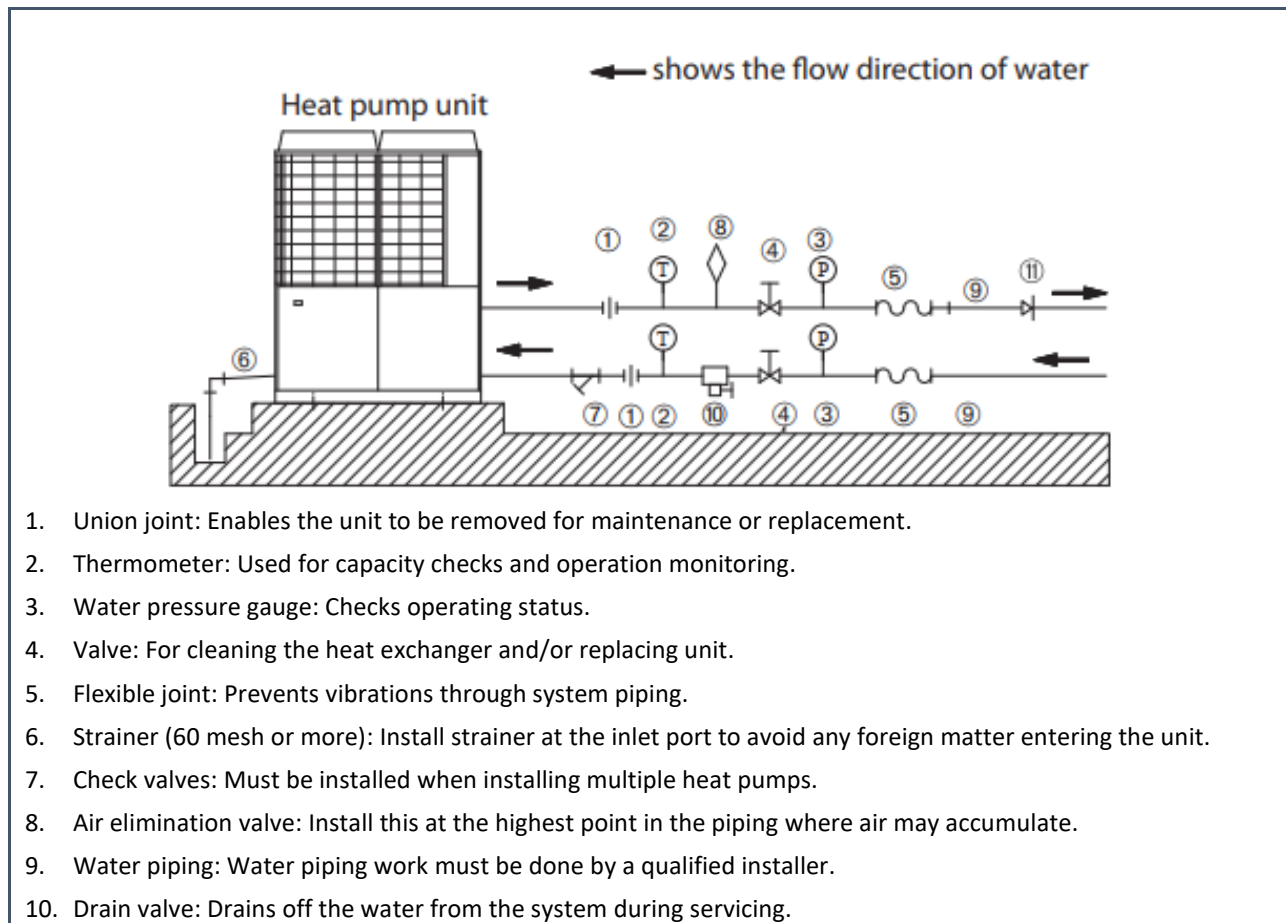**3.5.1 Recommended Hydraulic Circuit****Figure 5: Recommended Water Piping**

### 3.5.2 Key Considerations For Water Piping

**Water quality:** It is important to check in advance whether the feed water and hot water have good quality. Be sure to use water within the ranges specified in Section 3.7.

If solid matter such as sand piping debris, scale deposits, or floating suspended solids (i.e., any corrosion product in the water), the heat-transfer surface of the heat exchanger is directly attacked by water flow, and corrosion may be created. In order to avoid such corrosion by these substances, be sure to fit a cleanable strainer (60 mesh /0.25mm or smaller) at the water inlet port of the unit to remove any debris.

Depending on the type of metal, certain metals may cause localized corrosion when they make contact with each other. Including non-conductive materials between metals the metals can limit corrosion.

Water piping should have no leaks or air intrusion. If air is introduced at the suction side of pumps, the pump may create excess noise and performance may decrease.

For units exposed to freezing temperatures, take precautions to prevent the freezing of piping.

**NOTE:** Aegis A has a freeze protection function, but Aegis W does not. For any outdoor piping that may experience freezing conditions it is recommended to include a proper glycol mixture in the primary loop in case of power loss if the piping will be exposed to freezing temperatures. Contact your glycol supplier for further details on freeze protection.

Units installed indoors or in warmer climates should NOT have glycol included in the mixture.

## 3.6 Hydraulic Connection To The Heat Pump

### IMPORTANT!

The primary circuit should be set up in such a way as to guarantee a constant flow of water to the exchanger in all operating conditions. If this is not the case, there is a risk of refrigerant returning to the compressor input in a liquid state, which could damage the compressor.

### ⚠ WARNING!

Do not operate hydraulic connections with open flame near or inside the unit.

### IMPORTANT!

To ensure the correct operation of each pump on the machine:

- Before starting, check that the pump shaft rotates freely, without mechanical impediments.
- Do NOT run the pump dry, unprimed, and below the minimum nominal water flow rate.
- Do NOT operate the pump with closed shut-off valves, on the suction and delivery side.
- NEVER use the pump when cavitation occurs.
- It is mandatory to fill and bleed the hydraulic circuit correctly before starting the pump.

## 3.7 Water Composition

Dissolved substances in the water can cause damage to the heat exchangers. It is mandatory to verify that the water parameters comply with this table:

|  |  |
|--|--|
| Total hardness   | 1.2 to 3.5 grains/gal<br>[2.0 to 6.0 °F] |
| Langelier index  | - 0.4 to + 0.4                           |
| pH   | 7.5 to 8.5                               |
| Electrical conductivity  | 10 to 500 QS/cm                          |
| Organic element  | -  |
| Hydrogen carbonate (HCO <sub>3</sub> <sup>-</sup> )  | 70 to 300 ppm                            |
| Sulphates (SO <sub>4</sub> <sup>2-</sup> )   | < 50 ppm                                 |
| Hydrogen carbonate / Sulphates (HCO <sub>3</sub> <sup>-</sup> /SO <sub>4</sub> <sup>2-</sup> ) | > 1                                      |
| Chlorides ( Cl <sup>-</sup> )  | < 50 ppm                                 |
| Nitrates (NO <sub>3</sub> <sup>-</sup> )   | < 50 ppm                                 |
| Sulphuric acid (H <sub>2</sub> S)  | < 0.05 ppm                               |
| Ammonia (NH <sub>3</sub> )   | < 0.05 ppm                               |
| Sulphites (SO <sub>3</sub> ), free chlorine (Cl <sub>2</sub> )                                 | < 1 ppm                                  |
| Carbon dioxide (CO <sub>2</sub> )  | < 5 ppm                                  |
| Metal cations  | < 0.2 ppm                                |
| Manganese ions ( Mn <sup>++</sup> )  | < 0.1 ppm                                |
| Iron ions ( Fe <sup>2+</sup> , Fe <sup>3+</sup> )  | < 0.2 ppm                                |
| Iron + Manganese   | < 0.5 ppm                                |
| Phosphates (PO <sub>4</sub> <sup>3-</sup> )  | < 2 ppm                                  |
| Oxygen   | < 0.1 ppm                                |

**Table 1 – Water Quality Requirements**

If water is used that does not meet the criteria in the table, the warranty is immediately rendered null and void.

It is mandatory to set up a system that eliminates the possible organic substances in the water that could pass through the filter and settle in the heat exchangers, which would lead to malfunction and/ or damage over time.

If the water used in the unit contains organic substances, the warranty is immediately rendered null and void.

### 3.8 Discharge of Safety Valves

#### ⚠ WARNING!

To avoid personal injury and property damage due to valve operation, the safety valve must be installed so that any discharge runs to a safe place of disposal. Consult with your local plumbing codes and standards for any additional requirements.

**SECTION 4: WIRING AND ELECTRIC CONNECTIONS**


**4.1 Overview**

- The electrical connections must follow the information shown on the wiring diagram attached to the unit and the local regulations of where the unit is being installed.
- Verify that the power supply voltage corresponds to the nominal data of the unit (voltage, number of phases, frequency), as stated on the plate on the machine.
- The power supply voltage must not undergo variations over  $\pm 5\%$ .

**IMPORTANT!**

- Use power cable fixing systems that resist abrasion and twisting stress.
- Make sure there is no voltage present before performing any operation on electric parts.
- The section of the cable and the line protections must follow the wiring diagram and the relevant table attached to the unit.
- The unit must operate with those limits; failure to do so will immediately void the warranty.

**4.2 Low Voltage and Sensors**

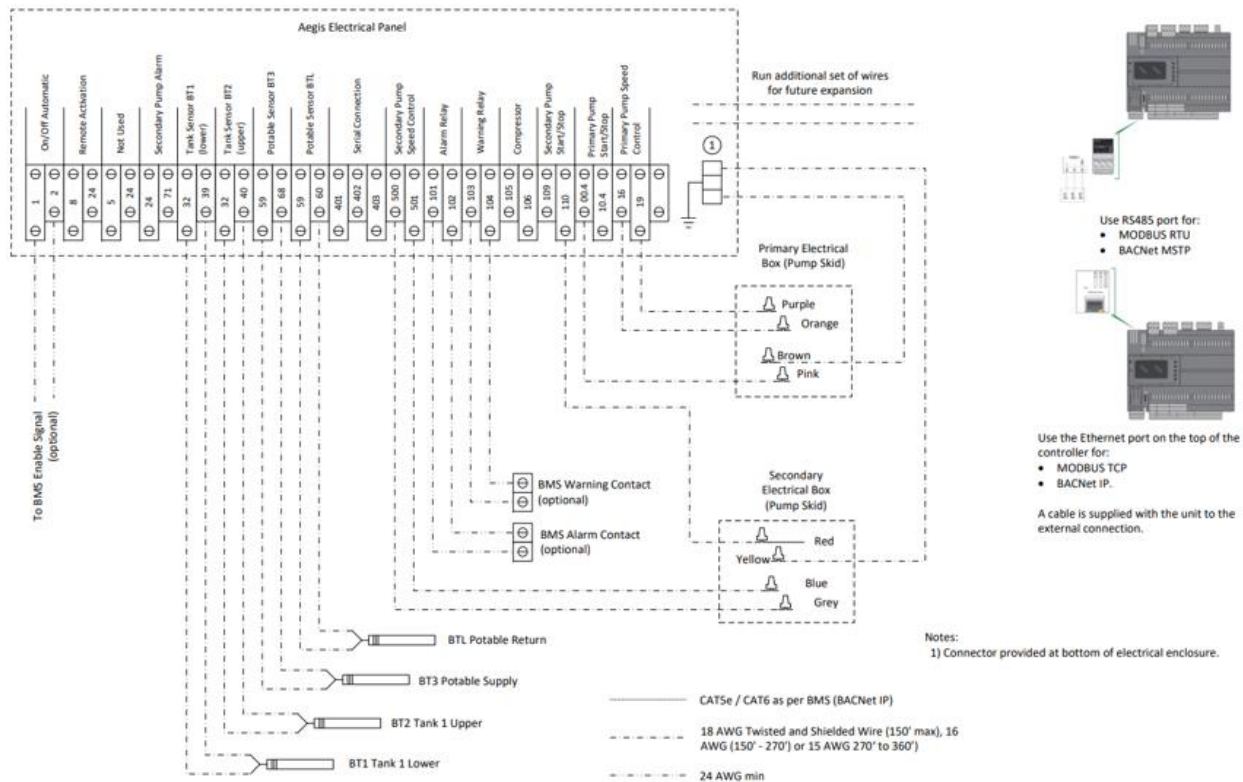

**Figure 6 – Low Voltage Connections to Aegis**

### 4.3 High Voltage

The Mark II Heat Exchanger Module only requires a 120V single phase 15 A power supply.

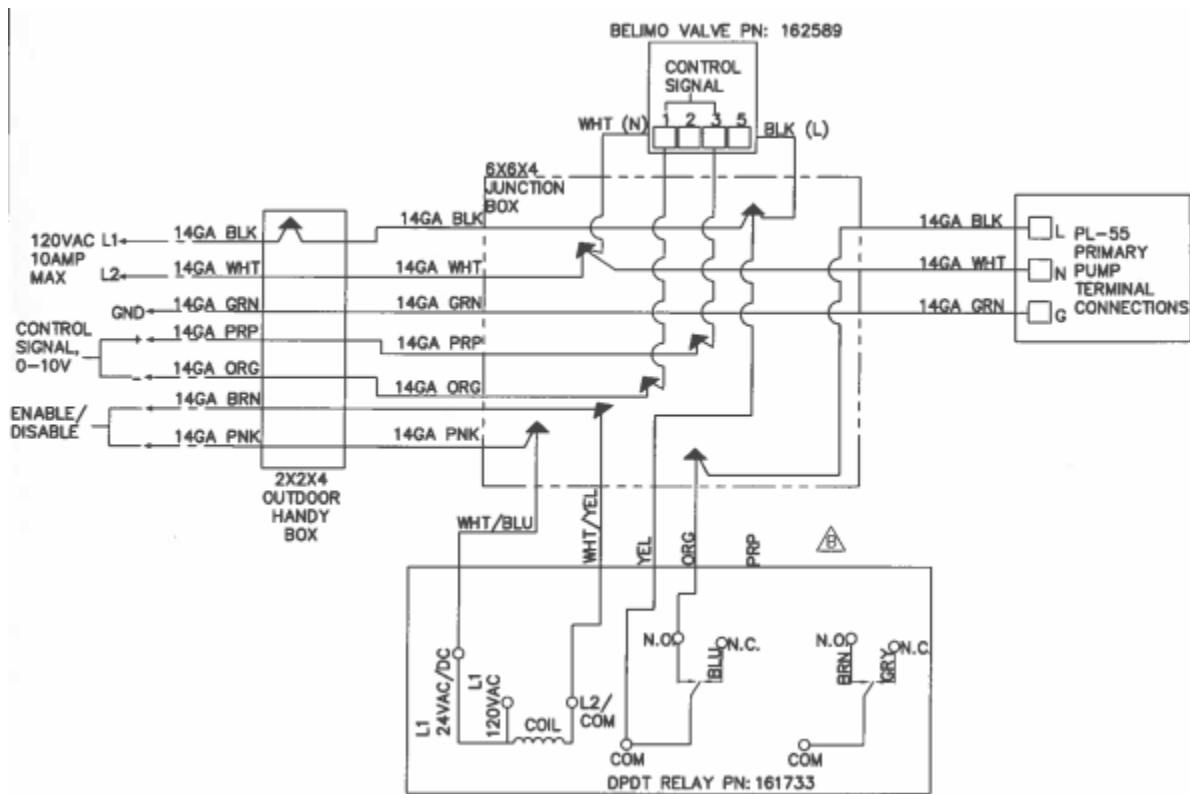


Figure 7 – Heat Exchange Module Wiring

### 4.4 Controller Function

Refer to the Lync Aegis Controller Manual L-OMM-013, supplied separately.

**SECTION 5: STARTUP****⚠ WARNING!**

The machine should be started up only by authorized and qualified personnel.

Additional startup details may be found in L-OMM-012 Installation, Operation, and Maintenance Manual.

**5.1 Preliminary Verifications**

Check for the following conditions before startup:

- Electrical connection has been implemented correctly and that all clamps are tightly fastened.
- Phase voltage on the RST clamps is 460 V  $\pm$  5% (line voltage should show 277V  $\pm$  3%). If the voltage is subject to frequent variations, contact Lync technical services or your local rep for the selection of relevant protections.
- Pressure in the refrigerant circuits is shown on the control display.
- Use a leak detector intended for R-744 refrigerant to check for any refrigerant fluid leaks.
- the power supply of the guard resistances

**⚠ WARNING!**

The resistances must be inserted at least 12 hours before the initial start-up, and takes place automatically when the master switch is closed.

To check the correct functioning of the resistances, check that the lower part of the compressors is hot and is at a temperature of 5-8°F (10-15°C) over the environmental temperature.

- Check that the hydraulic connections have been made correctly, with attention to the indications on the input/output plates on the machine.
- Check that the hydraulic system has been bled, thereby eliminating all residual air and loaded gradually, opening the vent devices in the upper part, which the installer would have set up together with an expansion tank of adequate capacity.

**IMPORTANT!**

Before starting-up, verify that all the closing panels of the unit are in place and secured.

**⚠ WARNING!**

All the units are pre-loaded with refrigerant gas, so the refrigerant circuit is pressurized. There is no need to charge the refrigerant circuit before unit start up.

**NOTE:** Additional information on startup is available in the Aegis Startup Checklist in L-OMM-012, Appendix A.

## 5.2 Filling the unit

It is critical when filling the primary loop to ensure all air is removed from the loop. Air separators must be used in the primary loop to ensure air is removed. The unit may be filled with a dedicated water fill line, or through the drain ports located on the heat exchanger module.

If connected to an Aegis A unit in an area that may experience freezing temperatures, it is recommended to add glycol to prevent accidental freeze damage.

## 5.3 Verifications During Operation

- Check that the sequence of the phases is correct. This can be verified by making sure that the fans are rotating in the correct direction (see Section 5.3). The fan should be pulling air in the side of the heat pump and directing it up out the top of the unit.
- Check that gas cooler inlet water temperature is near the electronic control setpoint.



## SECTION 6. DECOMMISSIONING

### 6.1 Seasonal Shutdown

- The Aegis heat pump water heater is designed for year-round operation. In the case that prolonged shutdown is expected, be sure to follow these steps
- Drain the hydraulic system (unless it contains glycol water).
- Repeat the procedure outlined in Section 5 on successive start-ups.

### 6.2 Emergency Stop

To stop in an emergency, turn off the main switch to power off the entire machine.

#### **IMPORTANT!**

Never modify the internal electrical connections, otherwise the warranty is immediately rendered null and void.

Disconnect voltage from the unit only in the case of prolonged shutdowns, to leave the compressors guard heating resistances powered.

#### **⚠ WARNING!**

Do not use the main power switch to enable or disable the heat pump: this device should be used to isolate the unit from the power supply when the unit is OFF. Removing voltage entirely depowers the guard resistances, jeopardizing the integrity of the compressor.

**SECTION 7. PERIODIC MAINTENANCE AND INSPECTIONS**

**⚠ WARNING!**

Before performing any service on the unit or accessing internal parts, make sure that the power supply has been disconnected.

The inverter of the compressor contains various parts that remain live for a few minutes after the power supply has been disconnected at the main switch.

Before any maintenance:

- Turn off the power to the Heat Exchanger Module by the field-provided power switch and the Aegis by the main power switch.
- Use a multimeter to make sure there is no voltage at the heads of the clamps.

**7.1 Overview**

It is good practice to carry out periodic inspections to verify the proper operation of the unit:

| OPERATION  | FREQUENCY                                   |
|--|---|
| Check the functioning of relief valve  | Annually                                    |
| Check for water or water/glycol mixture leaks in the hydraulic circuit.  | Monthly                                     |
| If the unit is to remain out of service for a long period, drain the water from the pipes and the heat exchanger. This is necessary whenever room temperatures are lower than the freezing point of the fluid used throughout the standstill period. | Seasonal                                    |
| Clean the strainers on the primary and secondary side of the heat exchanger module.  | Annually                                    |
| In the case of hard water, it may be necessary to run a descaling solution through the primary loop of the heat exchanger.   | Annually, or as required by site conditions |

**IMPORTANT!**

Routine maintenance of the unit is essential to the life of the machine. A lack of maintenance can cause malfunctioning and/or damage to the unit and render the warranty null and void.


**SECTION 8. TROUBLESHOOTING**


| Symptom                                | Cause                            | Corrective Action  |
|--|----------------------------------|--|
| High outlet temperature fault on Aegis | Insufficient primary loop flow.  | Ensure <b>all</b> air has been removed from primary loop. Even small amounts of air will cause insufficient flow<br>Verify primary pump operation<br>Verify primary valve opening on command<br>Verify Aegis output signal is set to 0-10V |
| High outlet temperature fault on Aegis | Insufficient secondary loop flow | Verify secondary pump operation<br>Verify secondary valve opening on command<br>Verify Aegis output signal is set to 0-10V   |
| High outlet temperature fault on Aegis | Primary valve not operating      | Verify control wiring polarity   |


**SECTION 9. DISPOSAL OF THE UNIT**


When the unit has reached the end of its intended duration and must be removed and replaced, the unit's structure and components, if no longer usable, should be taken down and grouped by the type of material. The unit contains large amounts of copper and steel. Separating the materials will help collection, disposal, and recycling centers and minimize the environmental impact.

APPENDIX A. MARK II SINGLE PARTS DRAWINGS

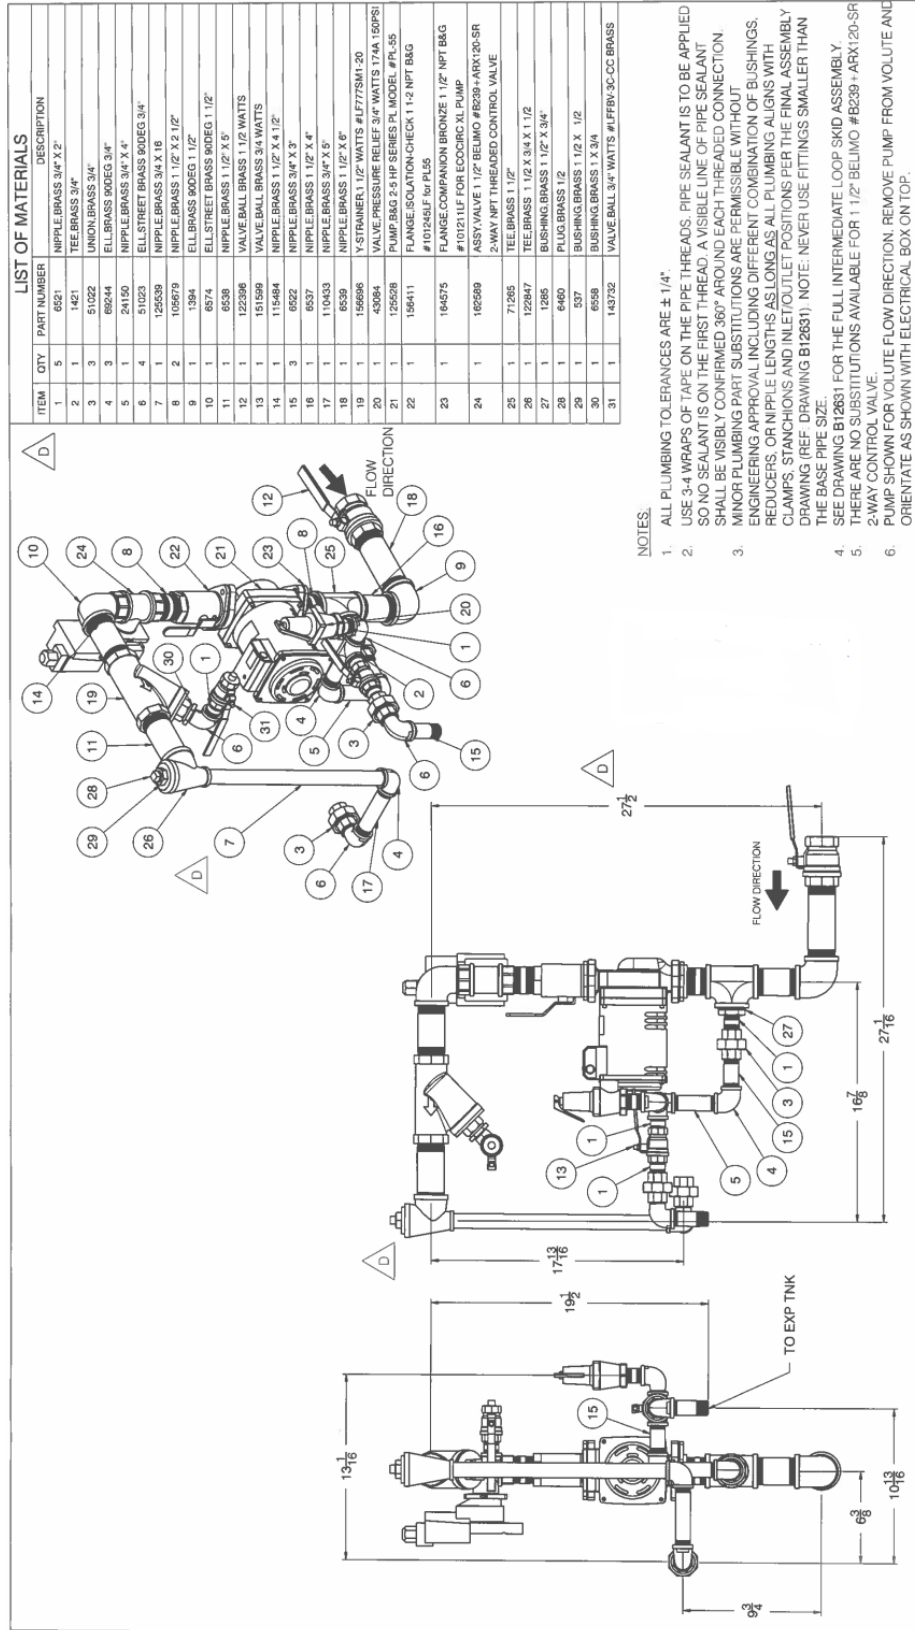

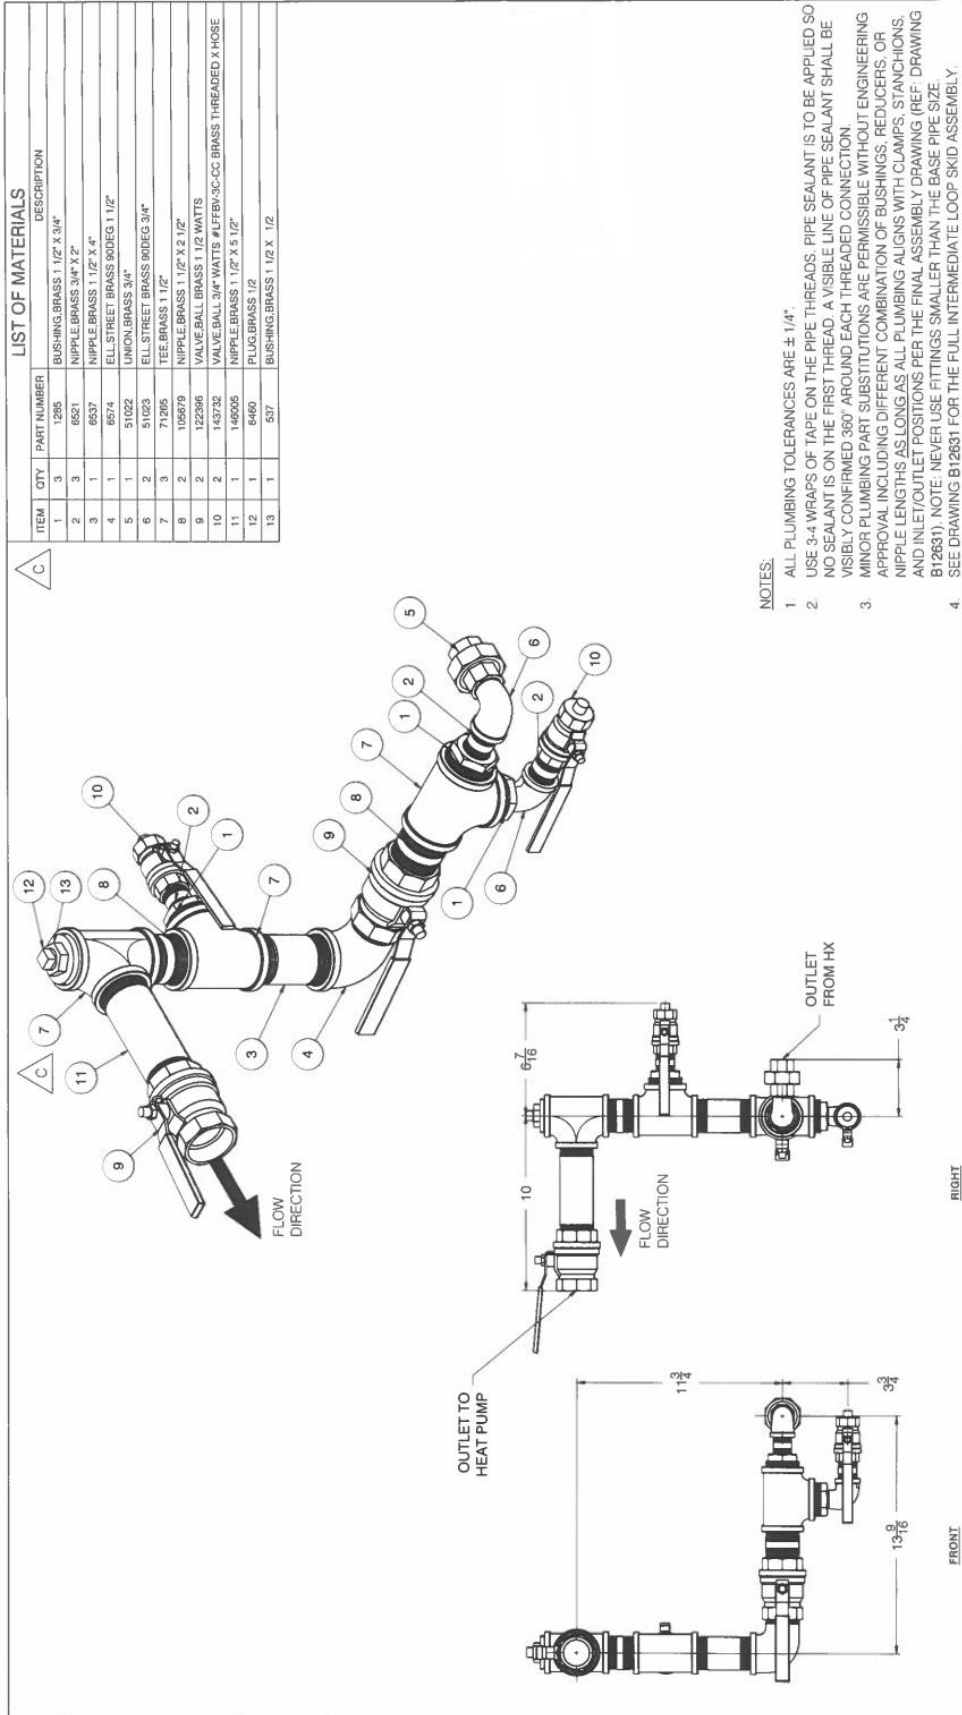

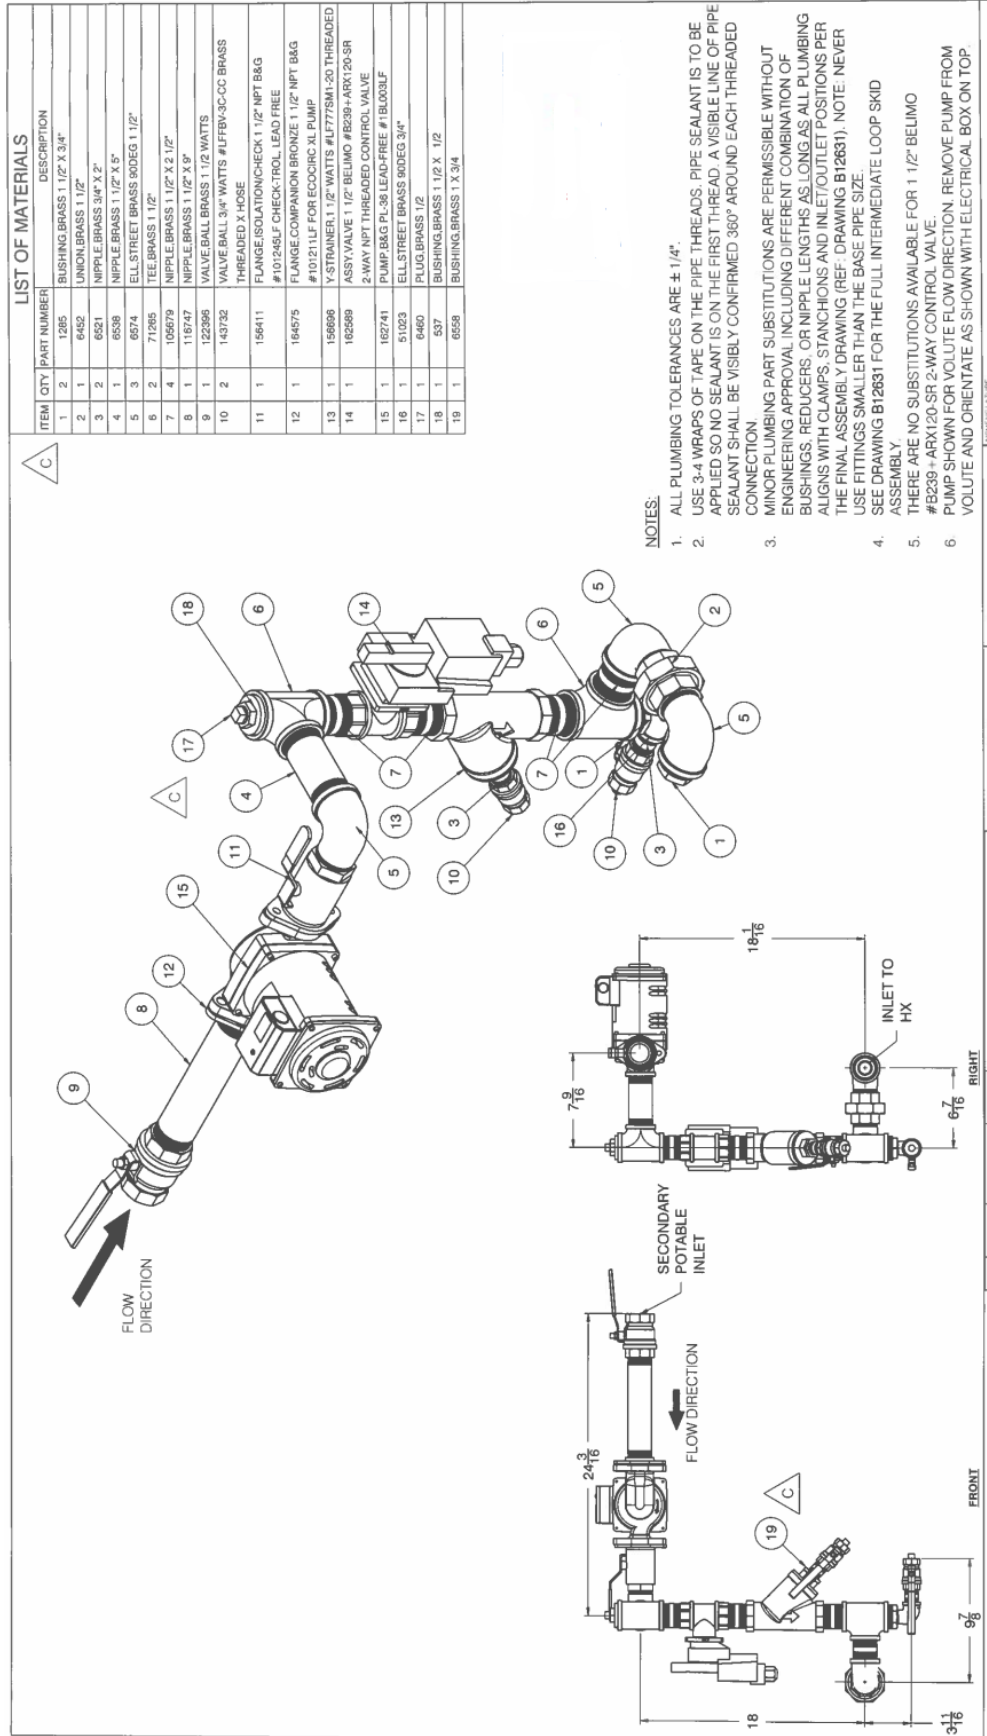

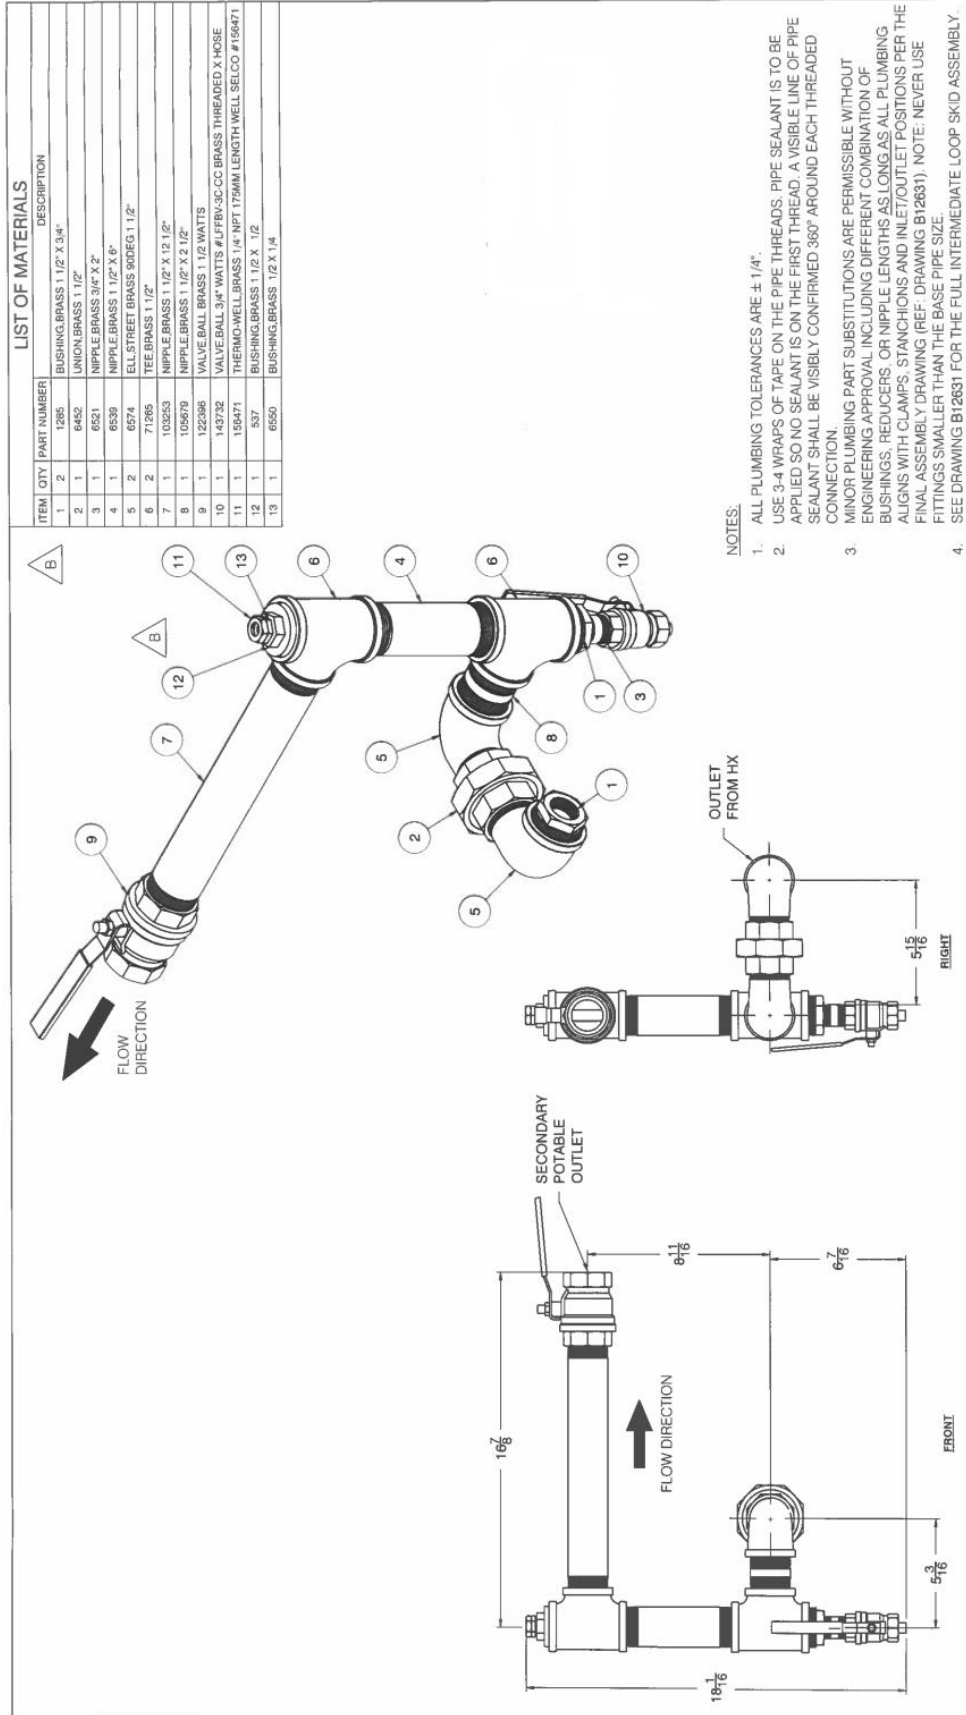

| ITEM | QTY  | PART NO./DWG. NO. | DESCRIPTION   |
|------|------|-------------------|---|
| 1    | 1    | 3438              | BOLT, 1/2" X 13 NC X 2 1/2" PLT HEX HEAD GR 8                             |
| 2    | 2    | 3486              | NUT, HEX, 1/2" X 13 NC GR8 PLT  |
| 3    | 2    | 5640              | CONNECTOR, 3/8" FLEXIBLE CONDUIT 90DEG ELL, STEEL/ALUM #1003 (NOT SHOWN)  |
| 4    | 18FT | 33217             | CONDUIT, 3/8" LIQUIDTITE (NOT SHOWN)                                      |
| 5    | 8    | 33218             | CONNECTOR, 3/8" LIQUIDTITE 90DEG (NOT SHOWN)                              |
| 6    | 2    | 42453             | COVER-HANDY BOX 2 X 2 X 4 WEATHERPROOF W/ GASKET                          |
| 7    | 2    | 42454             | BOX-HANDY 2X2X4 WEATHERPROOF 1/2 INCH HOLES                               |
| 8    | 7    | 143079            | U-BOLT, VIBRATION DAMPING FOR 1 1/2" PIPE MCMMASTER #3176T35              |
| 9    | 1    | 156847            | TANK EXPANSION WATTS DETA-20  |
| 10   | 2    | 101733            | RELAY ENCLOSED PRE-WIRED DROT GRANGER #2E1A3                              |
| 11   | 1    | 102596            | SWEP BOH/IDWH X 1.38" HEAT EXCHANGER                                      |
| 12   | 1    | 162680 / B12686   | ASSEMBLY, SWEP HX SUPPORT STANCHION FOR AEGIS SINGLE SWEP HX SKID COATED  |
| 13   | 1    | 162689 / B12687   | ASSEMBLY, PLUMBING SUPPORT STANCHION PRIMARY INLET SIDE, COATED           |
| 14   | 1    | 162698 / B12688   | ASSEMBLY, PLUMBING SUPPORT STANCHION SECONDARY INLET SIDE, COATED         |
| 15   | 1    | 162708 / B12689   | ASSEMBLY, PLUMBING SUPPORT STANCHION SECONDARY INLET SIDE, COATED         |
| 16   | 1    | 162712 / B12611   | ASSEMBLY, PLUMBING SUPPORT STANCHION SECONDARY OUTLET SIDE-WIDE, COATED   |
| 17   | 1    | 162722 / B12612   | ASSEMBLY, PLUMBING SUPPORT STANCHION SECONDARY OUTLET SIDE-NARROW, COATED |
| 18   | 1    | 162728 / B12613   | ASSEMBLY, SKID BASE FOR SINGLE SWEP HX, COATED                            |
| 19   | 1    | 162734 / B12617   | ASSEMBLY, PRIMARY OUTLET PLUMBING FOR AEGIS SINGLE HX SKID                |
| 20   | 1    | 162735 / B12618   | SUB-ASSEMBLY, PRIMARY INLET PLUMBING FOR AEGIS SINGLE HX SKID             |
| 21   | 1    | 168594 / B12619   | SUB-ASSEMBLY, PRIMARY INLET PLUMBING FOR AEGIS SINGLE HX SKID             |
| 22   | 1    | 162738 / B12620   | SUB-ASSEMBLY, SECONDARY OUTLET PLUMBING FOR AEGIS SINGLE HX SKID          |
| 23   | 1    | 162739 / B12621   | U-BOLT, VIBRATION DAMPING FOR 3/4" PIPE MCMMASTER #3176T32                |
| 24   | 2    | 162745            | U-BOLT, VIBRATION DAMPING FOR 3/4" PIPE MCMMASTER #3176T32                |
| 25   | 1    | 162749 / B12630   | ASSEMBLY, PLUMBING SUPPORT STANCHION SECONDARY INLET SIDE-BACK, COATED    |
| 26   | 1    | 163104 / B12687   | BRACE, RIGHT SIDE SINGLE SWEP HX SKID                                     |
| 27   | 1    | 163106 / B12687   | BRACE, BACK SIDE SINGLE SWEP HX SKID                                      |
| 28   | 2    | 163115            | ENCLOSURE, INDOOR WITH LIFT-OFF COVER AND KNOCKOUTS, 6" X 6" X 4"         |

**LIST OF MATERIALS**

**NOTES:**

- ORIENT THE EXPANSION TANK WITH THE GAUGES FACING FORWARD AS SHOWN. SEE ENGINEERING FOR EXPANSION TANK DRILL FIXTURE TO DRILL THREE HOLES FOR 5/16" BOLT INTO TANK BASE.
- MOUNT SWEP HX STANCHION AND HX ONTO SKID BASE FIRST (NOTE: THE STUDS ON THE SWEP HX ARE M8X20, P/N 154765). BEGIN WITH PRIMARY PLUMBING FIRST. MOUNTING CORRESPONDING STANCHIONS ONTO BASE TO ENSURE PLUMBING ALIGNS WITH THE HX, EXPANSION TANK, AND STANCHIONS.
- REPEAT THIS PROCESS WITH THE SECONDARY PLUMBING.
- USE 1/4"-20 BOLTS (P/N 55854), NUTS (P/N 3475), AND WASHERS (P/N 15607) TO MOUNT STANCHIONS ONTO BASE.
- USE 1/2" HEX NUTS, AND BOLTS TO SUPPORT THE POTABLE PUMP AS SHOWN IN THE FRONT VIEW.
- REFERENCE DRAWING B12688 FOR WIRING DIAGRAM
- NO COMPONENT, INCLUDING BALL VALVES OR CONTROL VALVES, SHALL OVERHANG THE SKID BASE AS SHOWN IN THE TOP VIEW. ROTATE VALVES IN CLOSED POSITION FOR SHIPPING.
- PLACE ARROW DECALS ON PLUMBING AS SHOWN IN THE TOP VIEW.
- PLUMBING LABELS FOR INLETS/OUTLETS ARE AS FOLLOWS:
  - ITEM 20 (PRIMARY OUTLET) = FROM HX OUTLET TO HEAT PUMP INLET
  - ITEM 21 (PRIMARY INLET) = FROM HEAT PUMP OUTLET TO HX INLET
  - ITEM 22 (SECONDARY INLET) = POTABLE INLET
  - ITEM 23 (SECONDARY OUTLET) = POTABLE OUTLET



**LIST OF MATERIALS**

| ITEM | QTY  | PART NO. / DWG. NO. | DESCRIPTION   |
|------|------|---------------------|---|
| 1    | 1    | 3486                | BOLT, 1/2" X 1.3 NC X 2, 1/2" PLT HEX HEAD CR 8                           |
| 2    | 2    | 3486                | NUT, HEX 1/2" X 1.3 NC GR8 PLT  |
| 3    | 2    | 5640                | CONNECTOR, 3/8" FLEXIBLE CONDUIT 90DEG ELL STEELALUM #11003 (NOT SHOWN)   |
| 4    | 1BFT | 33217               | CONDUIT, 3/8" LIQUIDITE (NOT SHOWN)                                       |
| 5    | 8    | 33218               | CONNECTOR, 3/8" LIQUIDITE 90DEG (NOT SHOWN)                               |
| 6    | 2    | 42453               | COVER, HANDY BOX 2 X 2 X 4 WEATHERPROOF W/ GASKET                         |
| 7    | 2    | 42454               | BOX, HANDY 2X2X4 WEATHERPROOF 1/2" INCH HOLES                             |
| 8    | 7    | 143979              | U-BOLT, VIBRATION DAMPING FOR 1 1/2" PIPE MCMMASTER #3176139              |
| 9    | 1    | 155647              | TANK EXPANSION WATTS DETA-20  |
| 10   | 2    | 161233              | RELAY ENCLOSED PRE-WIRED DPDT GRANGER #2ETAS                              |
| 11   | 1    | 162988              | SWEP BOW/160WH X139 HEAT EXCHANGER  |
| 12   | 1    | 162669 / B12606     | ASSEMBLY, SWEP HX SUPPORT STANCHION FOR AEGIS SINGLE SWEP HX SKID COATED  |
| 13   | 1    | 162667 / B12607     | ASSEMBLY, PLUMBING SUPPORT STANCHION PRIMARY INLET SIDE, COATED           |
| 14   | 1    | 162668 / B12608     | ASSEMBLY, PLUMBING SUPPORT STANCHION PRIMARY OUTLET SIDE, COATED          |
| 15   | 1    | 162709 / B12609     | ASSEMBLY, PLUMBING SUPPORT STANCHION SECONDARY INLET SIDE, COATED         |
| 16   | 1    | 162712 / B12611     | ASSEMBLY, PLUMBING SUPPORT STANCHION SECONDARY OUTLET SIDE, WIDE, COATED  |
| 17   | 1    | 162722 / B12612     | ASSEMBLY, PLUMBING SUPPORT STANCHION SECONDARY OUTLET SIDE NARROW, COATED |
| 18   | 1    | 162728 / B12613     | ASSEMBLY, PLUMBING SUPPORT STANCHION PRIMARY INLET SIDE, COATED           |
| 19   | 1    | 162734 / B12617     | ASSEMBLY, SKID BASE FOR SINGLE SWEP HX, COATED                            |
| 20   | 1    | 162735 / B12618     | SUB-ASSEMBLY PRIMARY INLET PLUMBING FOR AEGIS SINGLE HX SKID              |
| 22   | 1    | 162736 / B12620     | SUB-ASSEMBLY SECONDARY INLET PLUMBING FOR AEGIS SINGLE HX SKID            |
| 23   | 1    | 162739 / B12621     | SUB-ASSEMBLY SECONDARY OUTLET PLUMBING FOR AEGIS SINGLE HX SKID           |
| 24   | 2    | 162745              | U-BOLT, VIBRATION DAMPING FOR 3/4" PIPE MCMMASTER #3176132                |
| 25   | 1    | 162746 / B12630     | ASSEMBLY, PLUMBING SUPPORT STANCHION SECONDARY INLET SIDE, COATED         |
| 26   | 1    | 163104 / B12667     | BRACE, BACK SIDE SINGLE SWEP HX SKID                                      |
| 27   | 1    | 163106 / B12667     | BRACE, RIGHT SIDE SINGLE SWEP HX SKID                                     |
| 28   | 2    | 163115              | ENCLOSURE INDOOR WITH LIFT-OFF COVER AND KNOCKOUTS, 8" X 6" X 4"          |
| 21   | 1    | 166947 / B12619     | SUB-ASSEMBLY PRIMARY INLET PLUMBING FOR AEGIS SINGLE HX SKID              |


**NOTES:**


- ORIENT THE EXPANSION TANK WITH THE GAUGES FACING FORWARD AS SHOWN. SEE ENGINEERING FOR EXPANSION TANK DRILL FUTURE TO DRILL THREE HOLES FOR 5/16" BOLT INTO TANK BASE.
- MOUNT SWEP HX STANCHION AND HX ONTO SKID BASE FIRST (NOTE: THE STUDS ON THE SWEP HX ARE M8X20, PN 154765). BEGIN WITH PRIMARY PLUMBING FIRST, MOUNTING CORRESPONDING STANCHIONS ONTO BASE TO ENSURE PLUMBING ALIGNS WITH THE HX, EXPANSION TANK, AND STANCHIONS.
- REPEAT THIS PROCESS WITH THE SECONDARY PLUMBING.
- USE 1/4-20 BOLTS (PN 55654), NUTS (PN 3475), AND WASHERS (PN 15607) TO MOUNT STANCHIONS ONTO BASE.
- USE 1/2" HEX NUTS AND BOLTS TO SUPPORT THE POTABLE PUMP AS SHOWN IN THE FRONT VIEW.
- REFERENCE DRAWING B12668 FOR WIRING DIAGRAM.
- NO COMPONENT, INCLUDING BALL VALVES OR CONTROL VALVES, SHALL OVERHANG THE SKID BASE AS SHOWN IN THE TOP VIEW. ROTATE VALVES IN CLOSED POSITION FOR SHIPPING.
- PLACE ARROW DECALS ON PLUMBING AS SHOWN IN THE TOP VIEW.
- PLUMBING LABELS FOR INLETS/OUTLETS ARE AS FOLLOWS:
  - ITEM 20 (PRIMARY INLET) = FROM HX OUTLET TO HEAT PUMP INLET
  - ITEM 21 (PRIMARY INLET) = FROM HEAT PUMP OUTLET TO HX INLET
  - ITEM 22 (SECONDARY INLET) = POTABLE INLET
  - ITEM 23 (SECONDARY OUTLET) = POTABLE OUTLET

TOP


FRONT


BACK

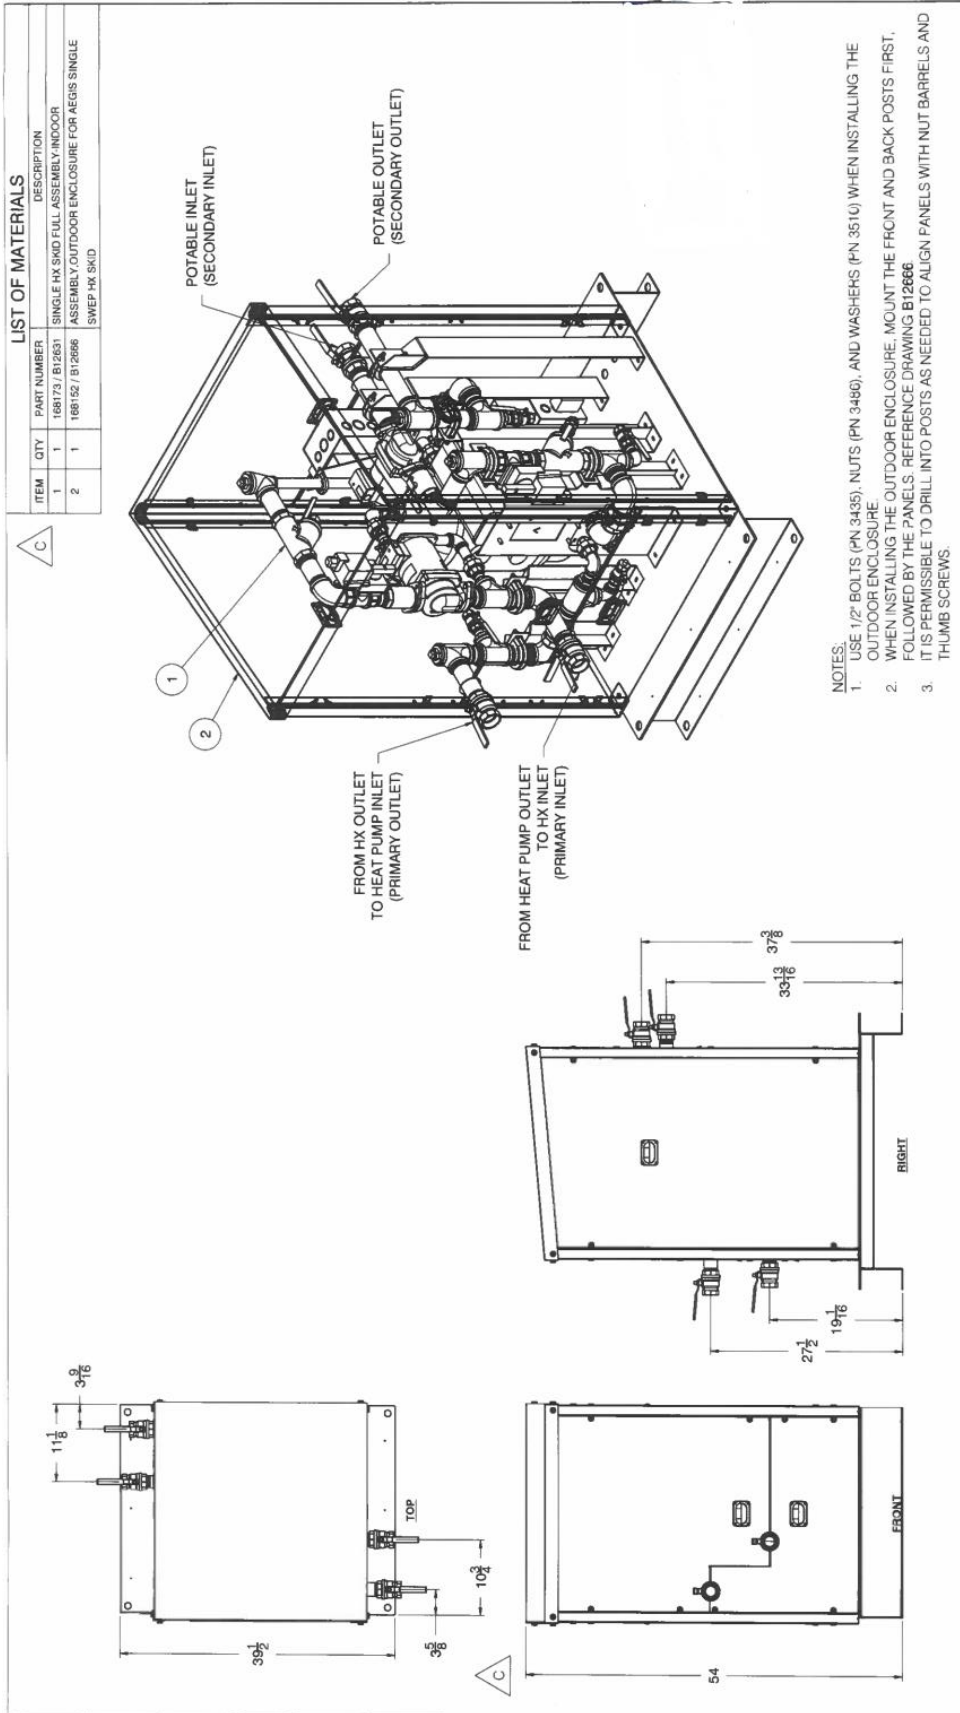


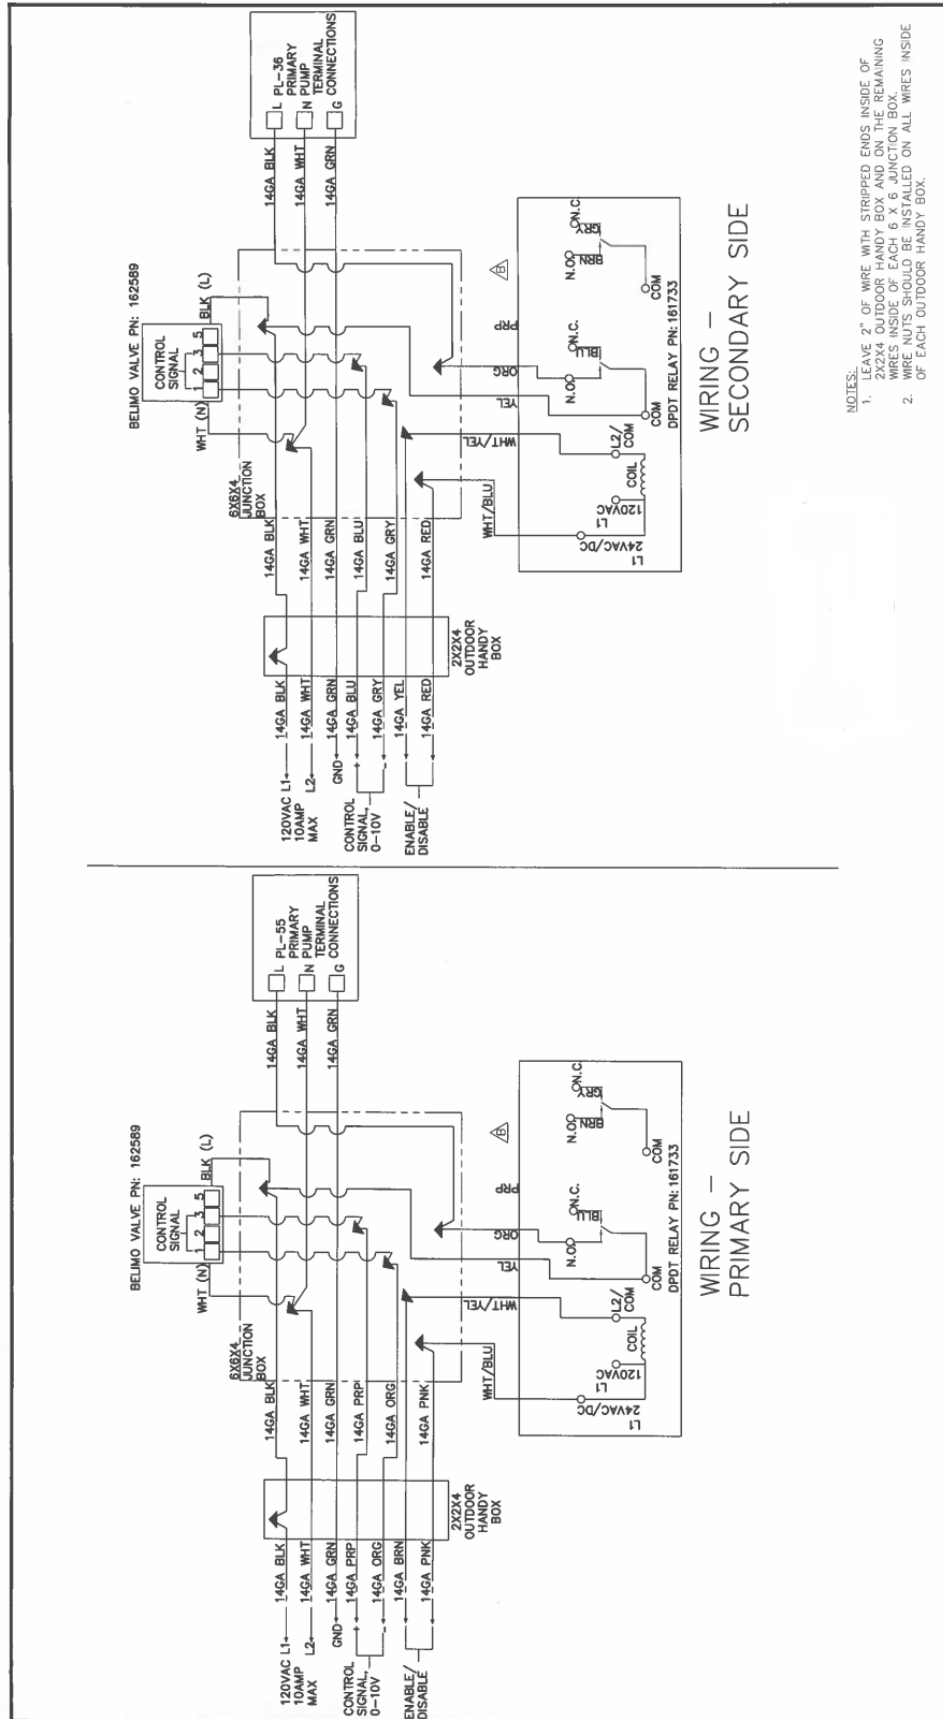



APPENDIX B. MARK II SINGLE PARTS DRAWINGS

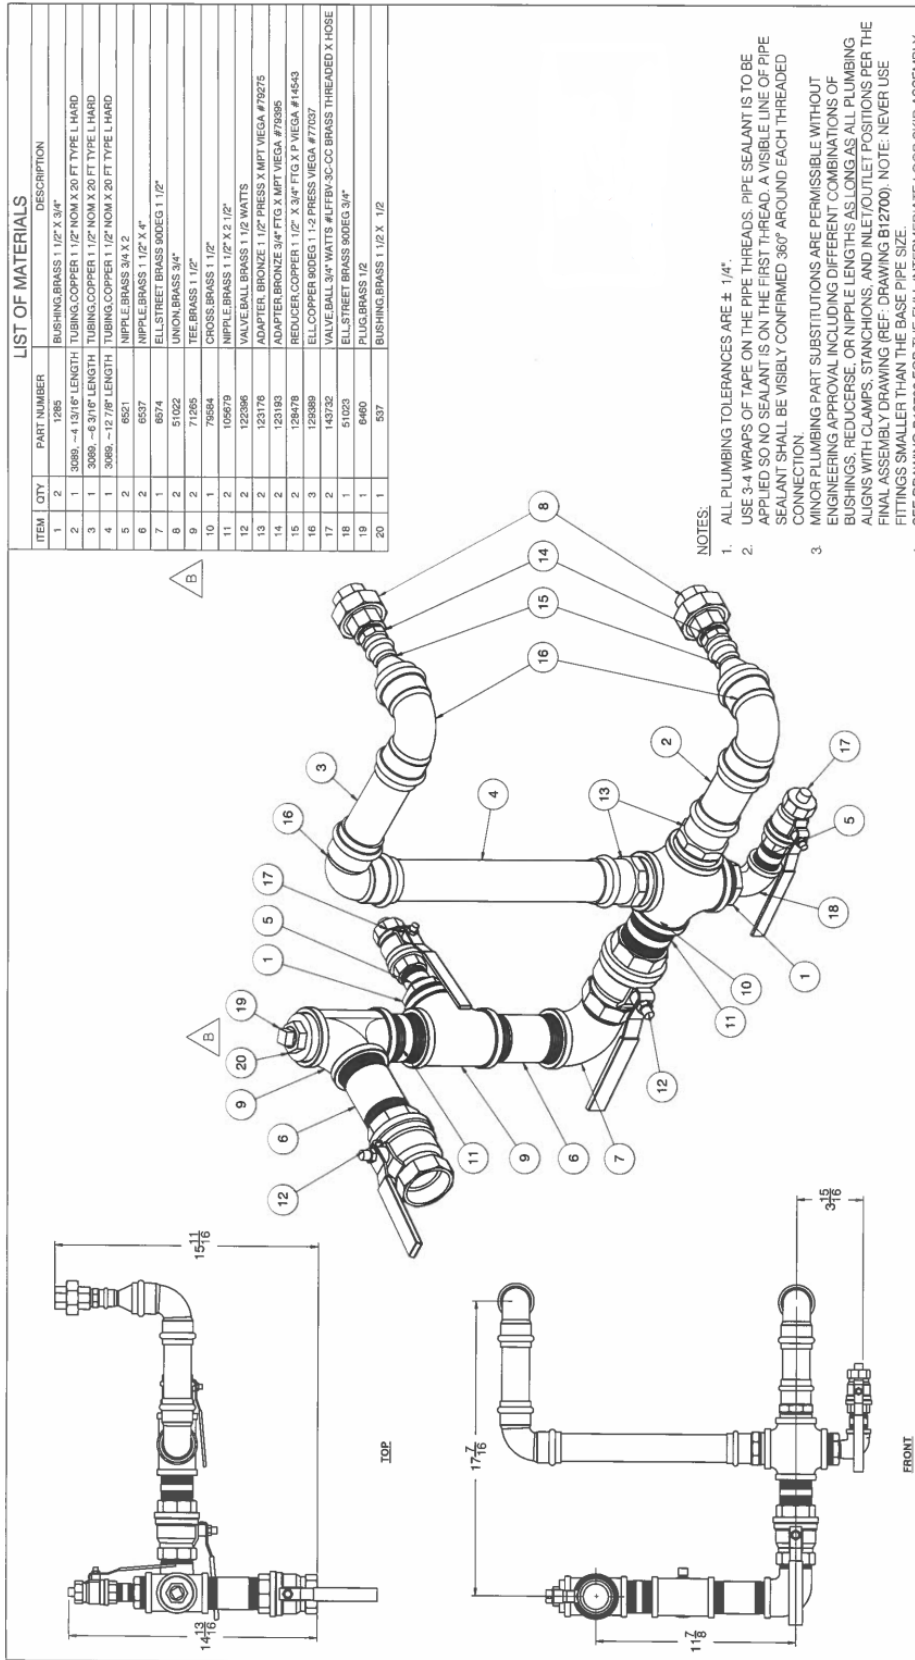

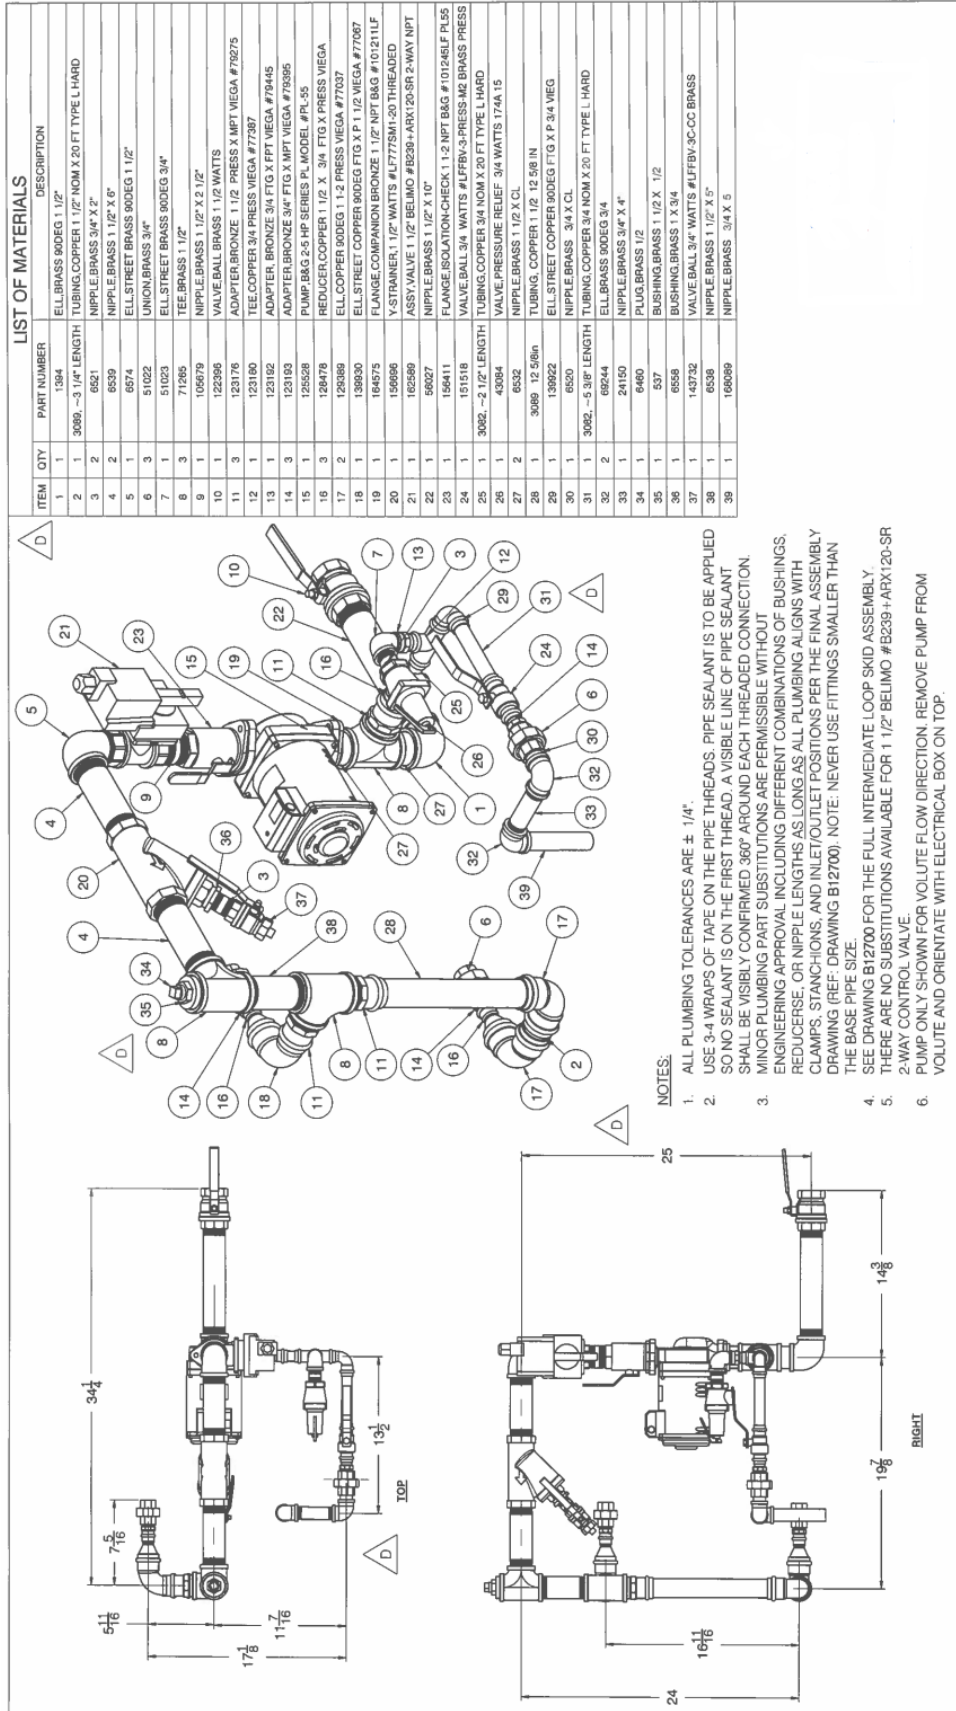

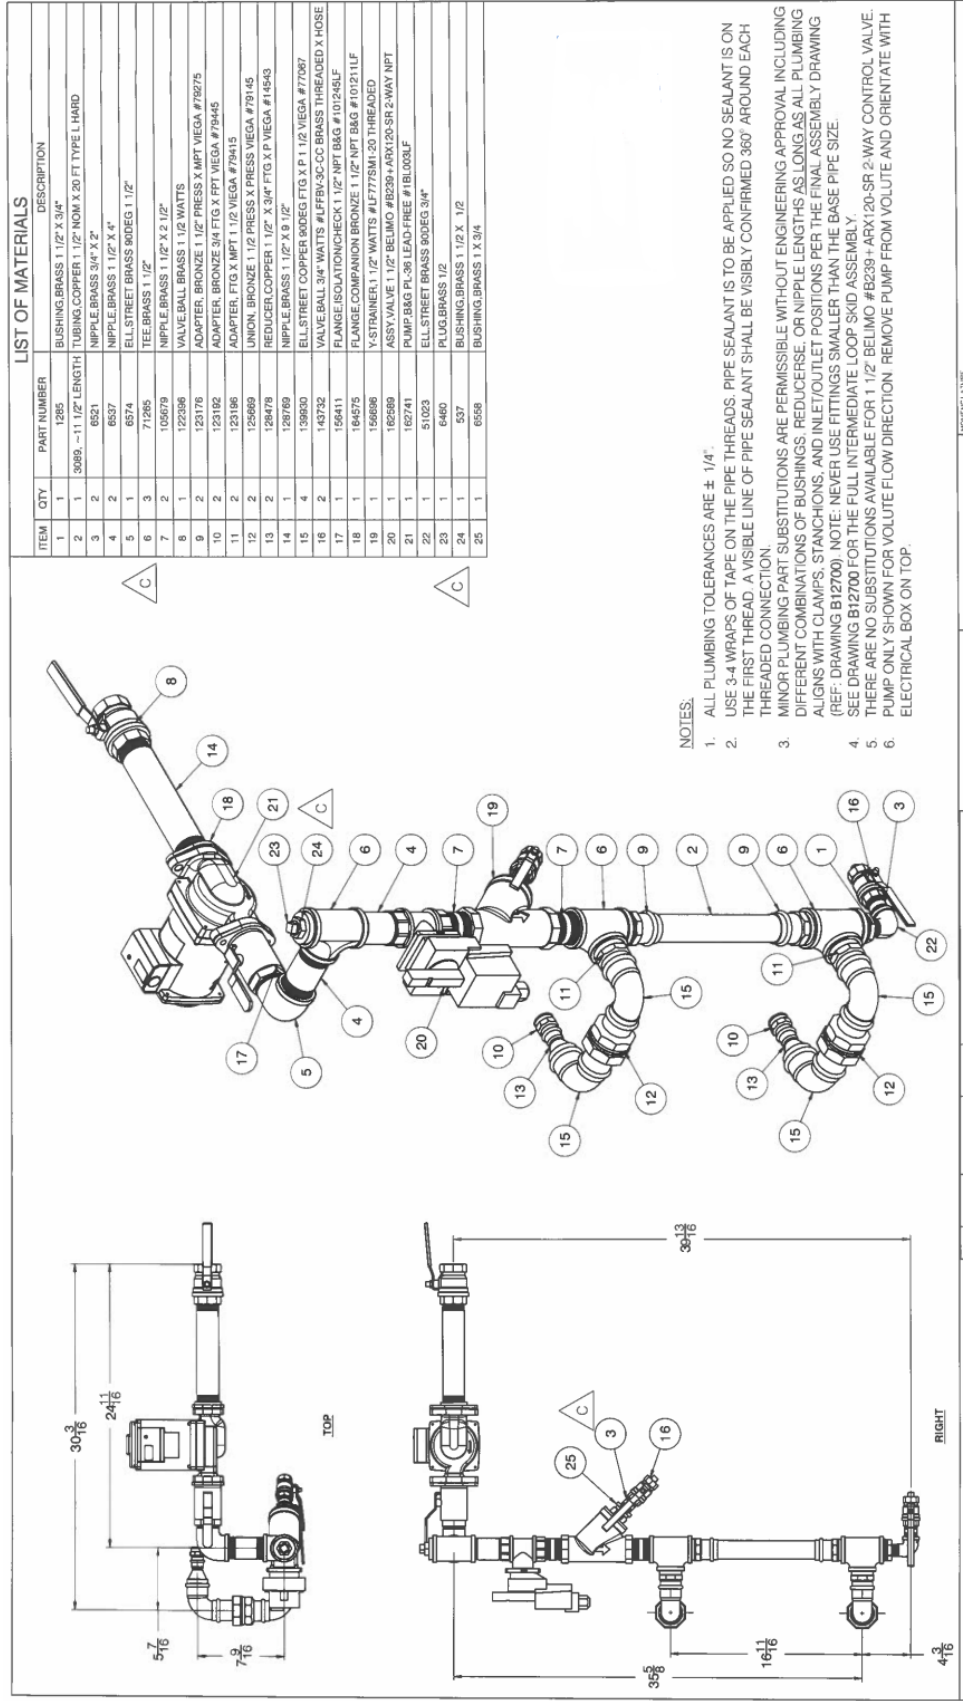

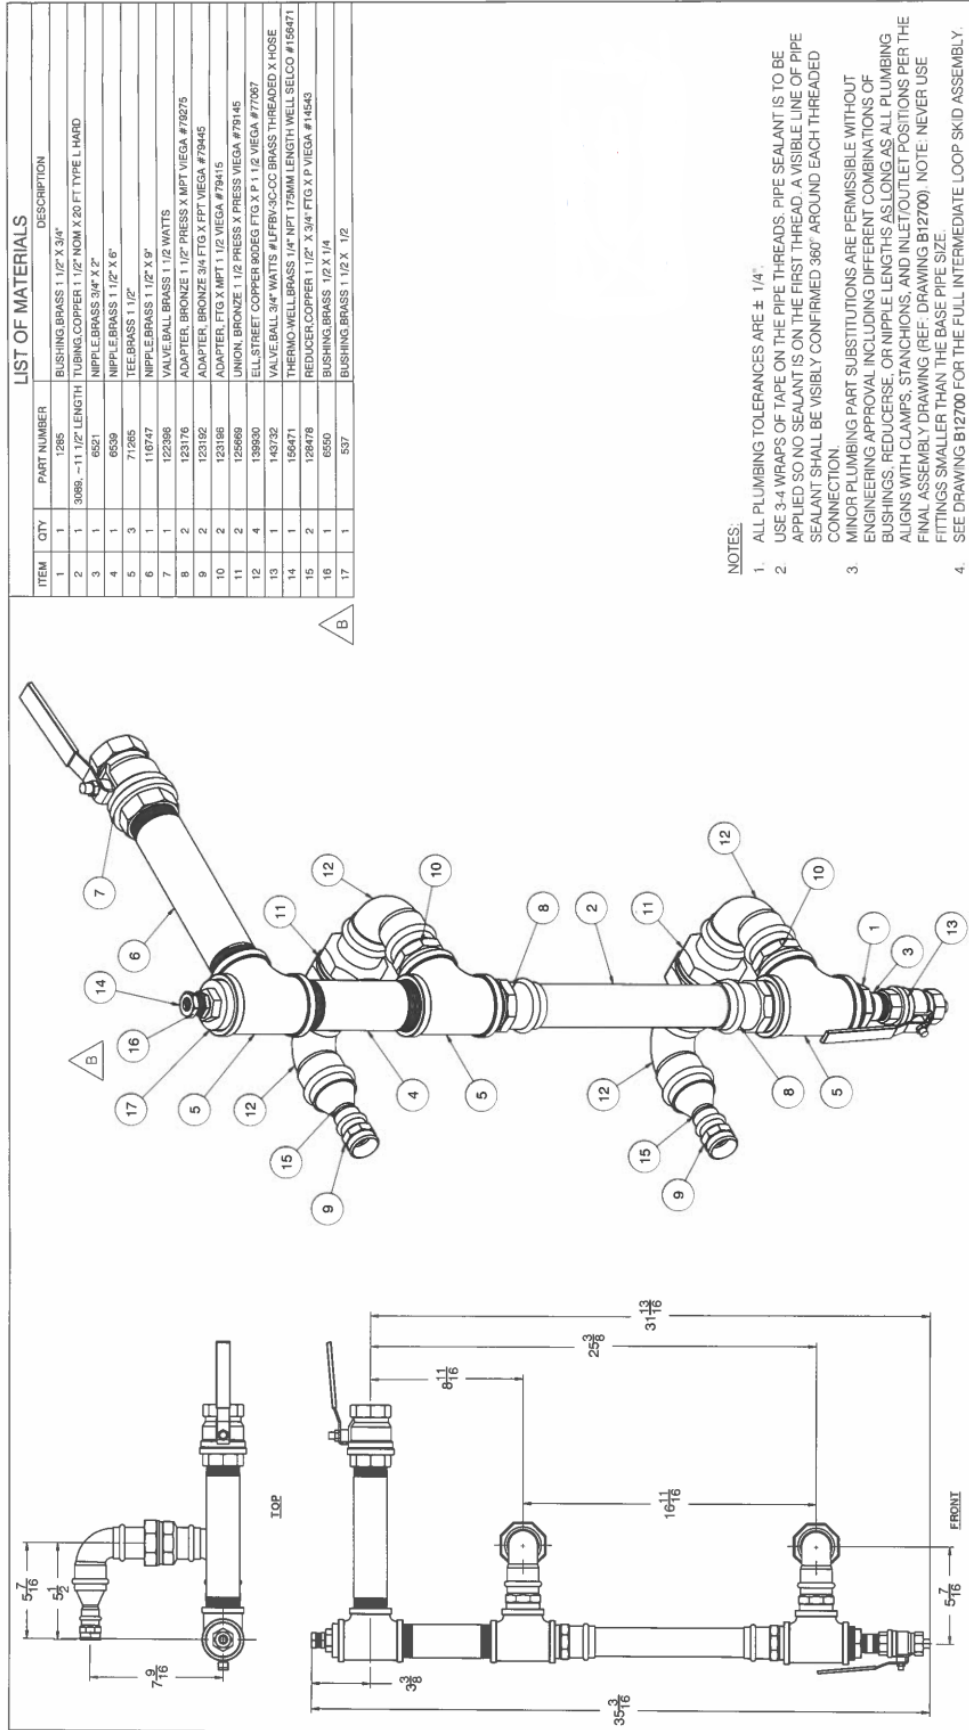

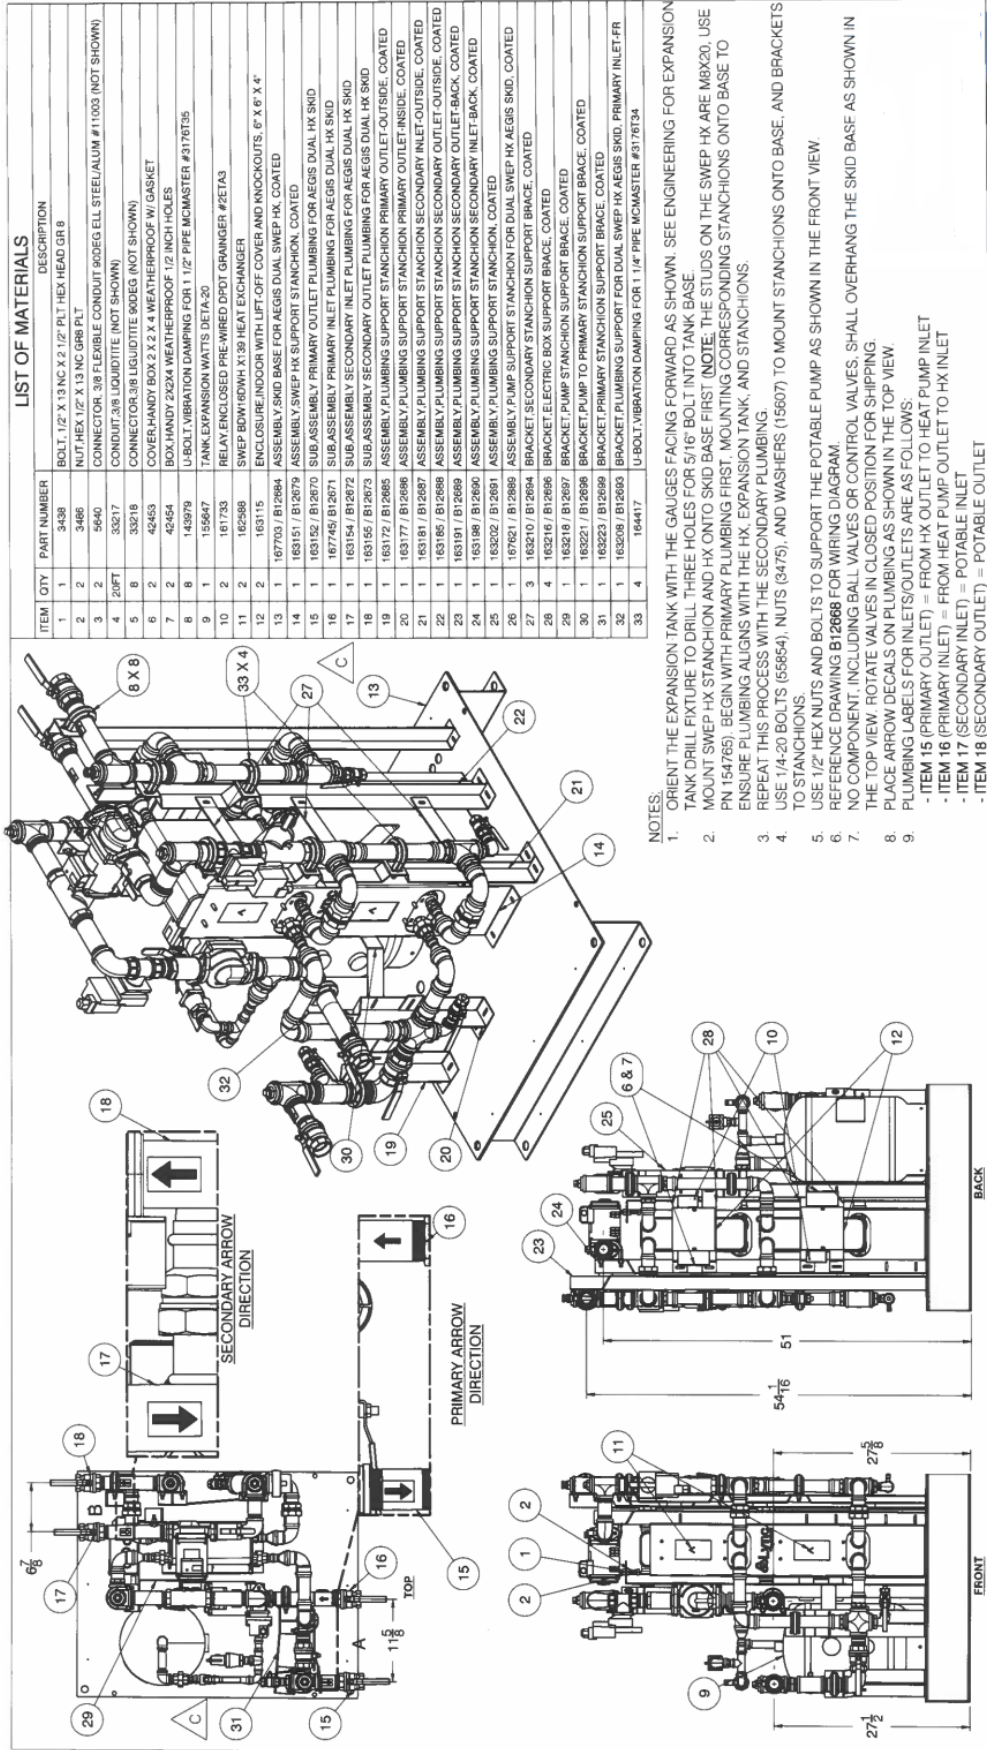



| LIST OF MATERIALS |      |  |
|-------------------|------|--|
| ITEM              | QTY  | PART NUMBER DESCRIPTION  |
| 1                 | 1    | 3438 BOLT, 1/2" X 1.31 NC X 2 1/2" PLT HEX HEAD GR 8                                   |
| 2                 | 2    | 3486 NUT, HEX 1/2" X 1.31 NC GR8 PLT   |
| 3                 | 2    | 5640 CONNECTOR, 3/8" FLEXIBLE CONDUIT 90DEG ELL STEEL/ALUM #11003 (NOT SHOWN)          |
| 4                 | 20FT | CONDUIT, 3/8" LIQUIDITE (NOT SHOWN)  |
| 5                 | 8    | 33216 CONNECTOR 3/8" LIQUIDITE 90DEG (NOT SHOWN)                                       |
| 6                 | 2    | 42453 COVER-HANDY BOX 2 X 2 X 4 WEATHERPROOF W/ GASKET                                 |
| 7                 | 2    | 42454 BOX-HANDY 292X4 WEATHERPROOF FOR 1 1/2" PIPE MCMMASTER #3178735                  |
| 8                 | 8    | 143979 U-BOLT, VIBRATION DAMPING FOR 1 1/2" PIPE MCMMASTER #3178735                    |
| 9                 | 1    | 155647 TANK EXPANSION WATTS DETA-20  |
| 10                | 2    | 161733 RELAY ENCLOSED PRE WIRED DPDT GRANNER #2ET43                                    |
| 11                | 2    | 162668 SWEP BOWI60WH X130 HEAT EXCHANGER   |
| 12                | 2    | 183115 ENCLOSURE INDOOR WITH LIFT OFF COVER AND KNOCKOUTS, 8" X 6" X 4"                |
| 13                | 1    | 167703 / B12684 ASSEMBLY SKID BASE FOR AEGIS DUAL SWEP HX, COATED                      |
| 14                | 1    | 163191 / B12679 ASSEMBLY SWEP HX SUPPORT STANCHION, COATED                             |
| 15                | 1    | 163192 / B12670 SUB ASSEMBLY PRIMARY INLET PLUMBING FOR AEGIS DUAL HX SKID             |
| 16                | 1    | 167745 / B12671 SUB ASSEMBLY PRIMARY INLET PLUMBING FOR AEGIS DUAL HX SKID             |
| 17                | 1    | 163154 / B12672 SUB ASSEMBLY SECONDARY INLET PLUMBING FOR AEGIS DUAL HX SKID           |
| 18                | 1    | 163155 / B12673 SUB ASSEMBLY SECONDARY INLET PLUMBING FOR AEGIS DUAL HX SKID           |
| 19                | 1    | 163172 / B12685 ASSEMBLY PLUMBING SUPPORT STANCHION PRIMARY OUTLET-OUTSIDE, COATED     |
| 20                | 1    | 163177 / B12686 ASSEMBLY PLUMBING SUPPORT STANCHION PRIMARY OUTLET-INSIDE, COATED      |
| 21                | 1    | 163191 / B12687 ASSEMBLY PLUMBING SUPPORT STANCHION SECONDARY INLET-OUTSIDE, COATED    |
| 22                | 1    | 163192 / B12688 ASSEMBLY PLUMBING SUPPORT STANCHION SECONDARY INLET-INSIDE, COATED     |
| 23                | 1    | 163191 / B12689 ASSEMBLY PLUMBING SUPPORT STANCHION SECONDARY OUTLET-BACK, COATED      |
| 24                | 1    | 163198 / B12690 ASSEMBLY PLUMBING SUPPORT STANCHION SECONDARY INLET-BACK, COATED       |
| 25                | 1    | 163202 / B12691 ASSEMBLY PLUMBING SUPPORT STANCHION, COATED                            |
| 26                | 1    | 167621 / B12689 ASSEMBLY PUMP SUPPORT STANCHION FOR DUAL SWEP HX AEGIS SKID, COATED    |
| 27                | 3    | 163210 / B12684 BRACKET SECONDARY STANCHION SUPPORT BRACE, COATED                      |
| 28                | 4    | 163218 / B12698 BRACKET ELECTRIC BOX SUPPORT BRACE, COATED                             |
| 29                | 1    | 163218 / B12697 BRACKET PUMP STANCHION SUPPORT BRACE, COATED                           |
| 30                | 1    | 163221 / B12698 BRACKET PUMP TO PRIMARY STANCHION SUPPORT BRACE, COATED                |
| 31                | 1    | 163223 / B12699 BRACKET PRIMARY STANCHION SUPPORT BRACE, COATED                        |
| 32                | 1    | 163208 / B12693 BRACKET PLUMBING SUPPORT FOR DUAL SWEP HX AEGIS SKID, PRIMARY INLET-FR |
| 33                | 4    | 164417 U-BOLT, VIBRATION DAMPING FOR 1 1/4" PIPE MCMMASTER #3178734                    |

**NOTES:**

- ORIENT THE EXPANSION TANK WITH THE GAUGES FACING FORWARD AS SHOWN. SEE ENGINEERING FOR EXPANSION TANK DRILL FIXTURE TO DRILL THREE HOLES FOR 5/16" BOLT INTO TANK BASE.
- MOUNT SWEP HX STANCHION AND HX ONTO SKID BASE FIRST (NOTE: THE STUDS ON THE SWEP HX ARE M8X20. USE PN 154765). BEGIN WITH PRIMARY PLUMBING FIRST. MOUNTING CORRESPONDING STANCHIONS ONTO BASE TO ENSURE PLUMBING ALIGNS WITH THE HX. EXPANSION TANK, AND STANCHIONS.
- REPEAT THIS PROCESS WITH THE SECONDARY PLUMBING.
- USE 1/4-20 BOLTS (65864), NUTS (6475), AND WASHERS (15607) TO MOUNT STANCHIONS ONTO BASE, AND BRACKETS TO STANCHIONS.
- USE 1/2" HEX NUTS AND BOLTS TO SUPPORT THE POTABLE PUMP AS SHOWN IN THE FRONT VIEW.
- REFERENCE DRAWING B12688 FOR WIRING DIAGRAM
- NO COMPONENT, INCLUDING BALL VALVES OR CONTROL VALVES, SHALL OVERHANG THE SKID BASE AS SHOWN IN THE TOP VIEW. ROTATE VALVES IN CLOSED POSITION FOR SHIPPING.
- PLACE ARROW DECALS ON PLUMBING AS SHOWN IN THE TOP VIEW.
- PLUMBING LABELS FOR INLET/OUTLETS ARE AS FOLLOWS:  
 - ITEM 15 (PRIMARY INLET) = FROM HX OUTLET TO HEAT PUMP INLET  
 - ITEM 16 (PRIMARY INLET) = FROM HEAT PUMP OUTLET TO HX INLET  
 - ITEM 17 (SECONDARY INLET) = POTABLE INLET  
 - ITEM 18 (SECONDARY OUTLET) = POTABLE OUTLET

